


TP – 357 Build approximately 16 miles of 345 kV line and Install 345/138 kV 560 MVA transformer at Fargo Substation

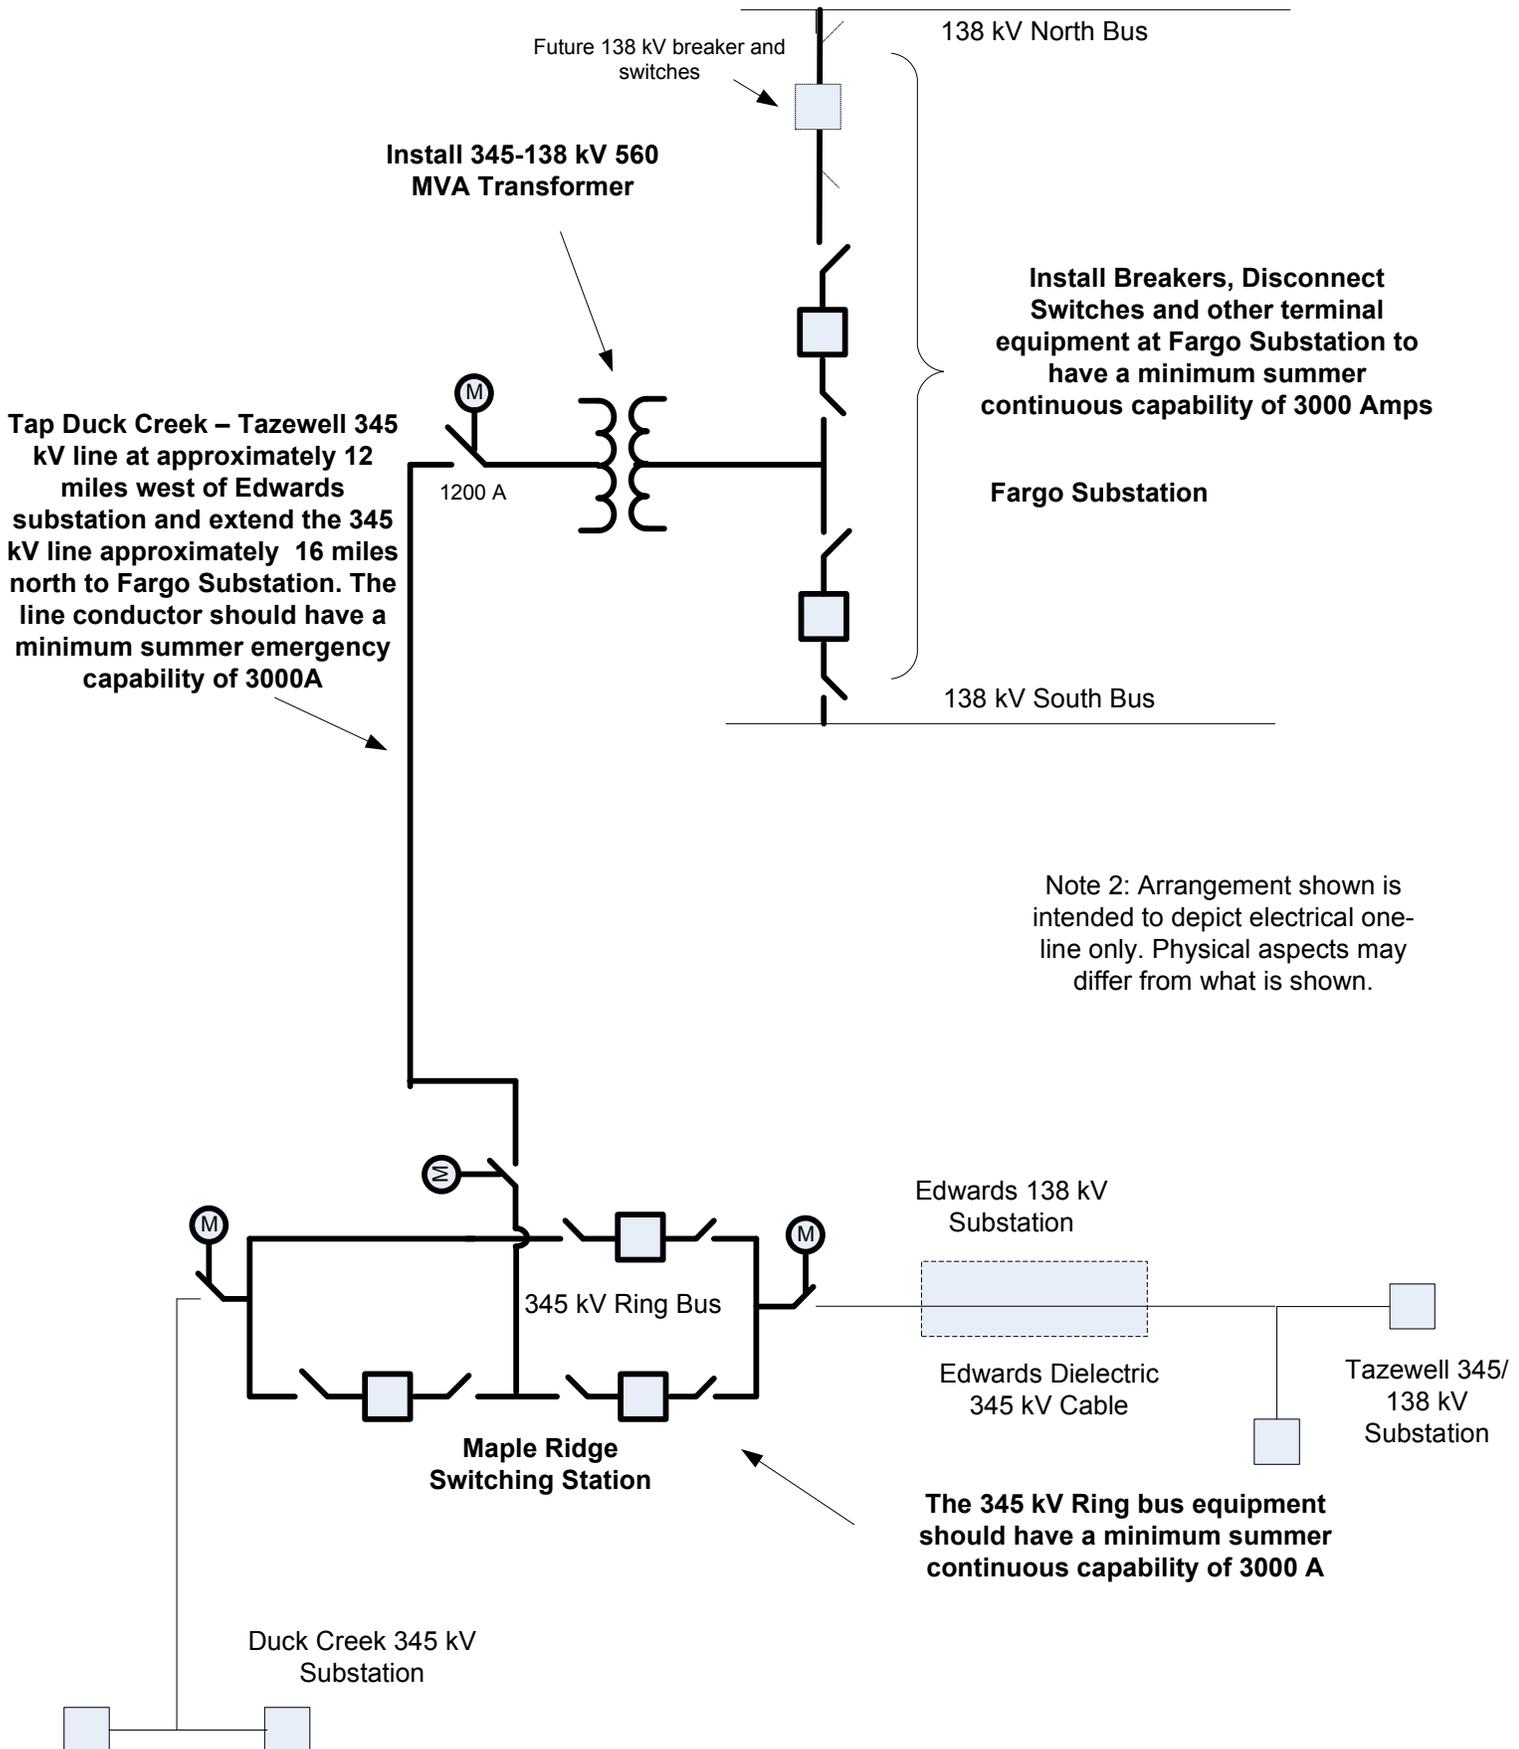

Possible Future Ultimate Development of Maple Ridge and Fargo Substations

Note : Arrangement shown is intended to depict electrical one-line only. Physical aspects may differ from what is shown.

As shown in the drawing, the dotted line indicates the future ultimate development of the 345 kV line.

