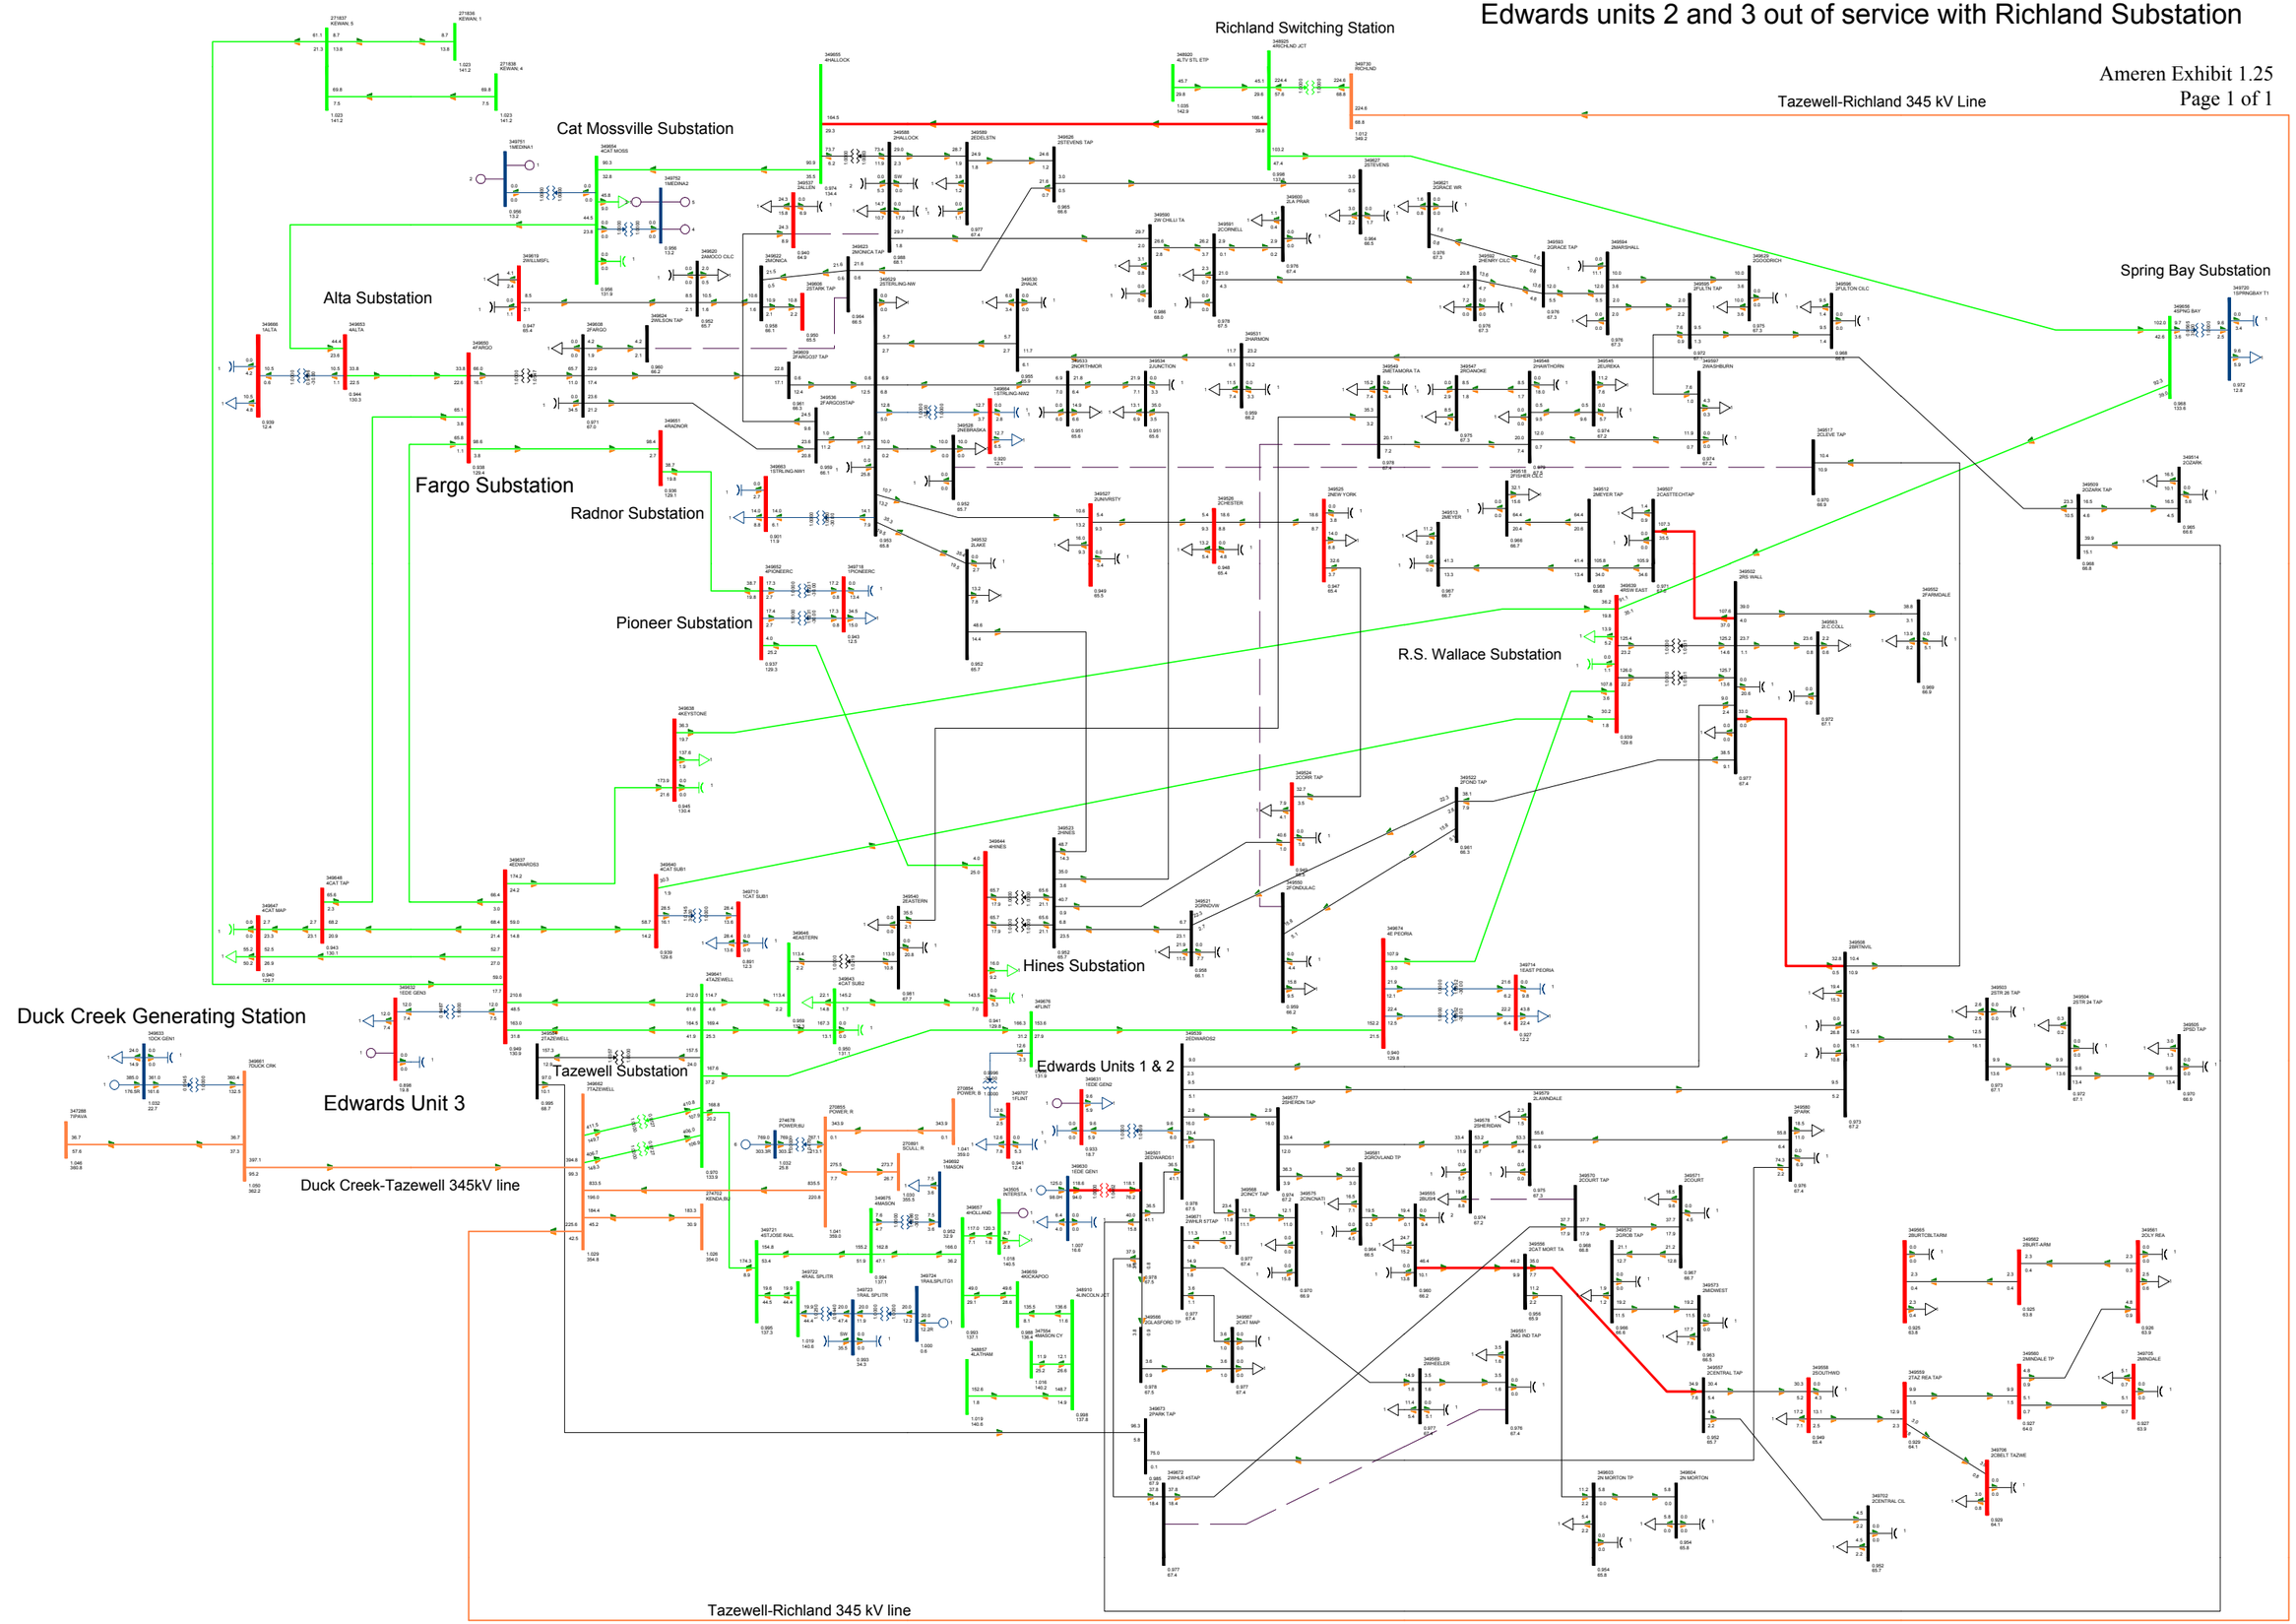Edwards units 2 and 3 out of service with Richland Substation