f#46 home n west 1: Soil Test

k

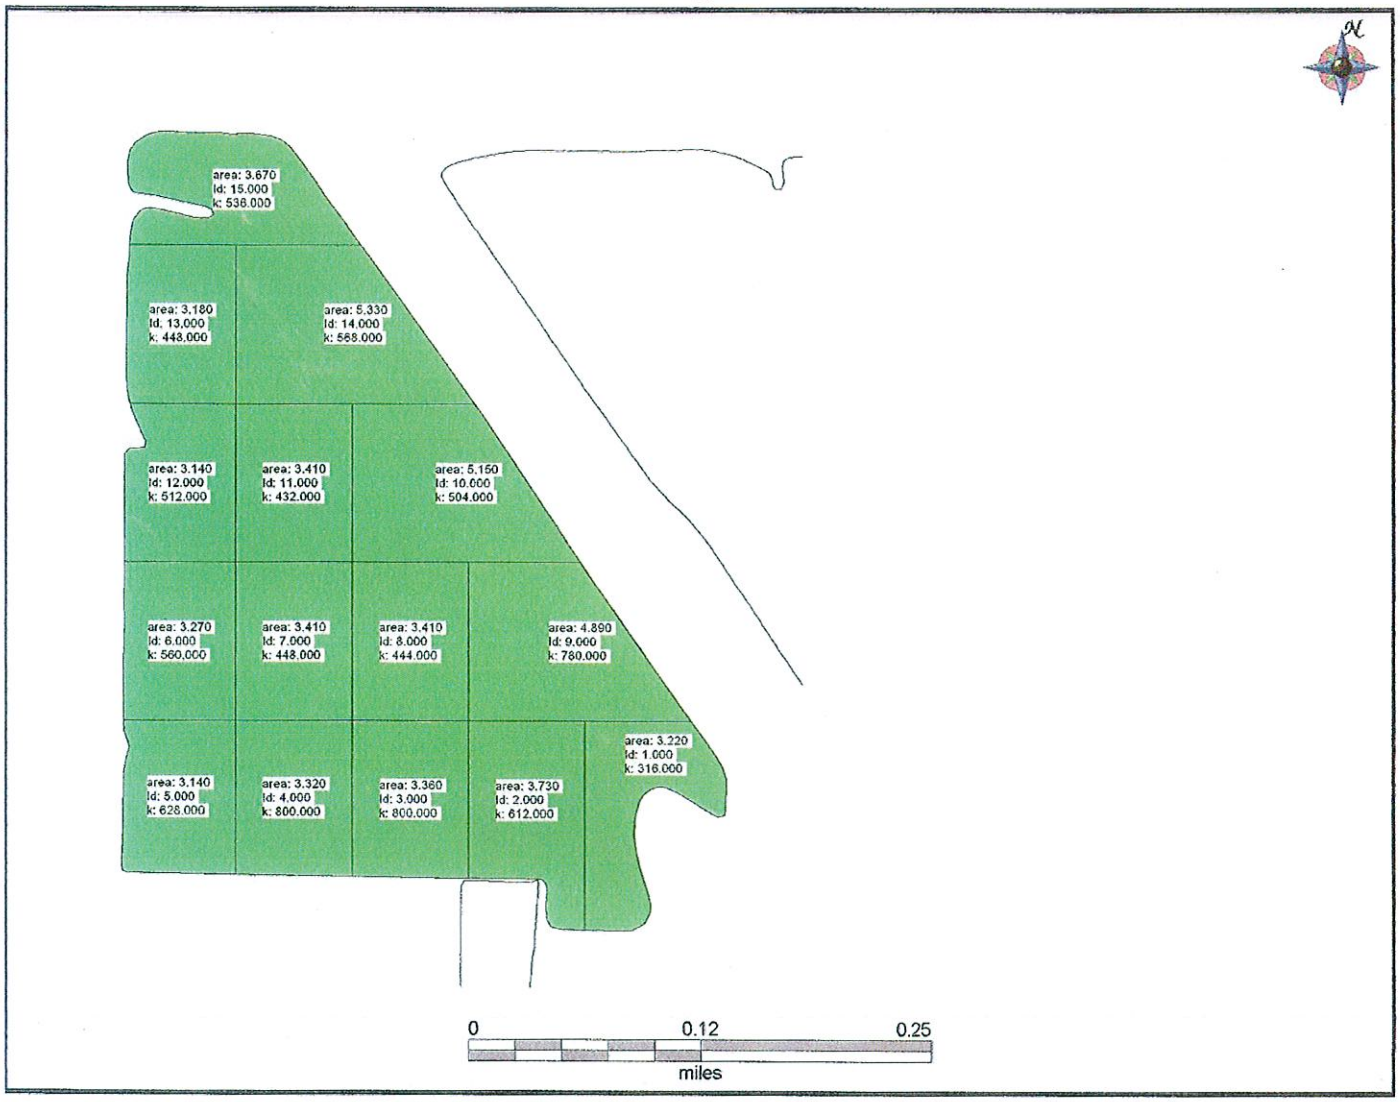

Client: < User Info. >
Field: f#46 home n west 1
Name: f 46 home 1 soiltest
Type: Soil Test
Area: 55.64 ac
Date: 11/28/2008
Min: 316.000
Max: 800.000
Avg: 559.200

Above 300.000	55.63 ac	
240.001 - 300.000	0.00 ac	
Below 240.001	0.00 ac	

LEGAL DESCRIPTION
NW SEC 03 3S8W -EX 20A SW COR & 29.49A H
WY & 25.96A S LN- NW SEC 3

KSI LABORATORIES

202 S. DACEY
SHELBYVILLE, ILLINOIS 62565
PHONE (217) 774-2421

OPERATOR: DAVID SIMPSON
FIELD: KAISER L47
ACRES:

LAB#: 283837-58 (26750)
DATE: 11/11/2010
SUBMITTED BY: OPERATOR S

SOIL TEST RESULTS

SAMPLE#	SOIL pH	BUFFER pH	PHOSPHORUS lbs/A	POTASSIUM lbs/A	CALCIUM lbs/A	MAGNESIUM lbs/A	ORGANIC MATTER %	CATION EXCHANGE CAPACITY	BASE SATURATION %Ca	%Mg	%K	%H
1	7.4	-	40	196	-	-	2.5	-	-	-	-	-
2	7.4	-	28	224	-	-	2.4	-	-	-	-	-
3	7.0	-	28	168	-	-	2.4	-	-	-	-	-
4	7.3	-	34	252	-	-	2.8	-	-	-	-	-
5	7.1	-	39	220	-	-	2.6	-	-	-	-	-
6	7.4	-	48	224	-	-	2.5	-	-	-	-	-
7	6.6	-	28	240	-	-	2.7	-	-	-	-	-
8	6.2	-	58	316	-	-	2.6	-	-	-	-	-
9	6.4	-	54	244	-	-	2.5	-	-	-	-	-
10	6.0	-	30	248	-	-	2.6	-	-	-	-	-
11	5.9	-	38	236	-	-	2.4	-	-	-	-	-
12	6.2	-	30	252	-	-	2.4	-	-	-	-	-
13	6.0	-	37	244	-	-	2.5	-	-	-	-	-
14	7.8	-	40	204	-	-	2.6	-	-	-	-	-
15	7.8	-	55	272	-	-	2.4	-	-	-	-	-
16	7.8	-	42	180	-	-	2.5	-	-	-	-	-
17	7.9	-	37	200	-	-	2.7	-	-	-	-	-
18	7.6	-	75	304	-	-	3.2	-	-	-	-	-
19	7.8	-	54	232	-	-	2.7	-	-	-	-	-
20	7.9	-	32	184	-	-	2.5	-	-	-	-	-
21	7.7	-	32	224	-	-	2.4	-	-	-	-	-
22	7.9	-	52	256	-	-	2.0	-	-	-	-	-
AVERAGE	7.1	-	41	233	-	-	2.5	-	-	-	-	-

PH AVE. 7.6 EXTRACTED SAMPLES: 7, 8, 9,10,11,12,13,
P1 AVE. 41 EXTRACTED SAMPLES:
K AVE. 233 EXTRACTED SAMPLES:

LEGAL DESCRIPTION
NE SEC 04 3S8W -EX 3.67A- E 1/2 NE SEC 4

ANALYTICAL SERVICES FOR AGRICULTURE

f#47 louise
Soil pH (pH)

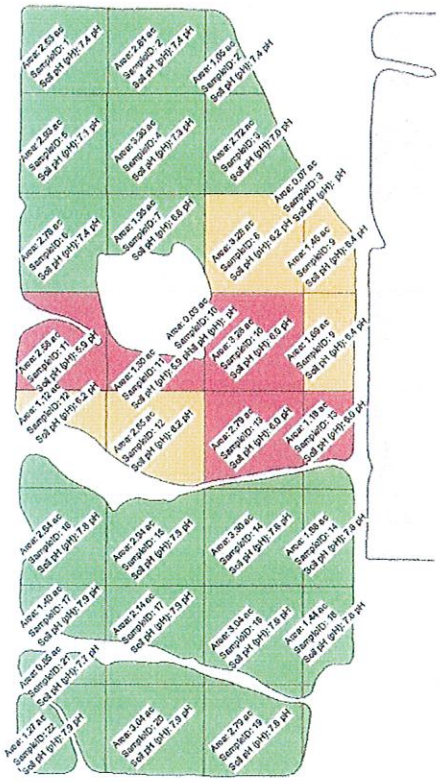

0 0.12 0.25
miles

Client: < Unassigned Client >
Farm: Louise Farm
Field: f#47 louise
Name: f#47 louise soil test 2010
Min: 5.9 pH
Max: 7.9 pH
Avg: 7.2 pH

6.6 - 7.9 pH	49.79 ac	
6.2 - 6.5 pH	10.41 ac	
5.9 - 6.1 pH	11.13 ac	

LEGAL DESCRIPTION
NE SEC 04 3S8W -EX 3.67A- E 1/2 NE SEC 4