


Example Of Potential Split 345 kV Ring Bus At Kincaid

NORMAL OPERATION assuming a new line to Mt Zion is added to the ring bus

All breakers closed

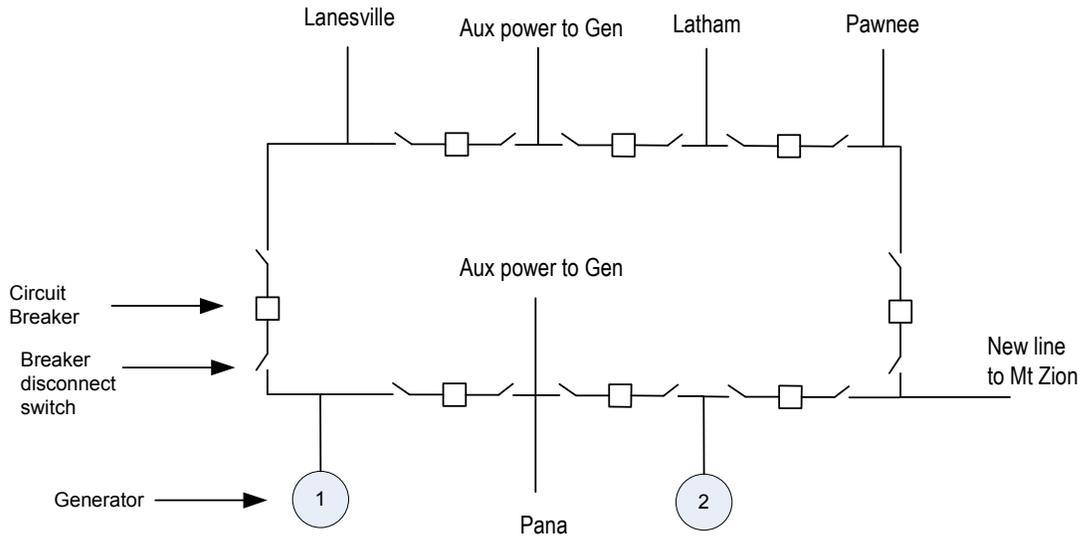

SPLIT RING BUS CONDITION

Kincaid Generation connected to only Pana and new Mt Zion lines

