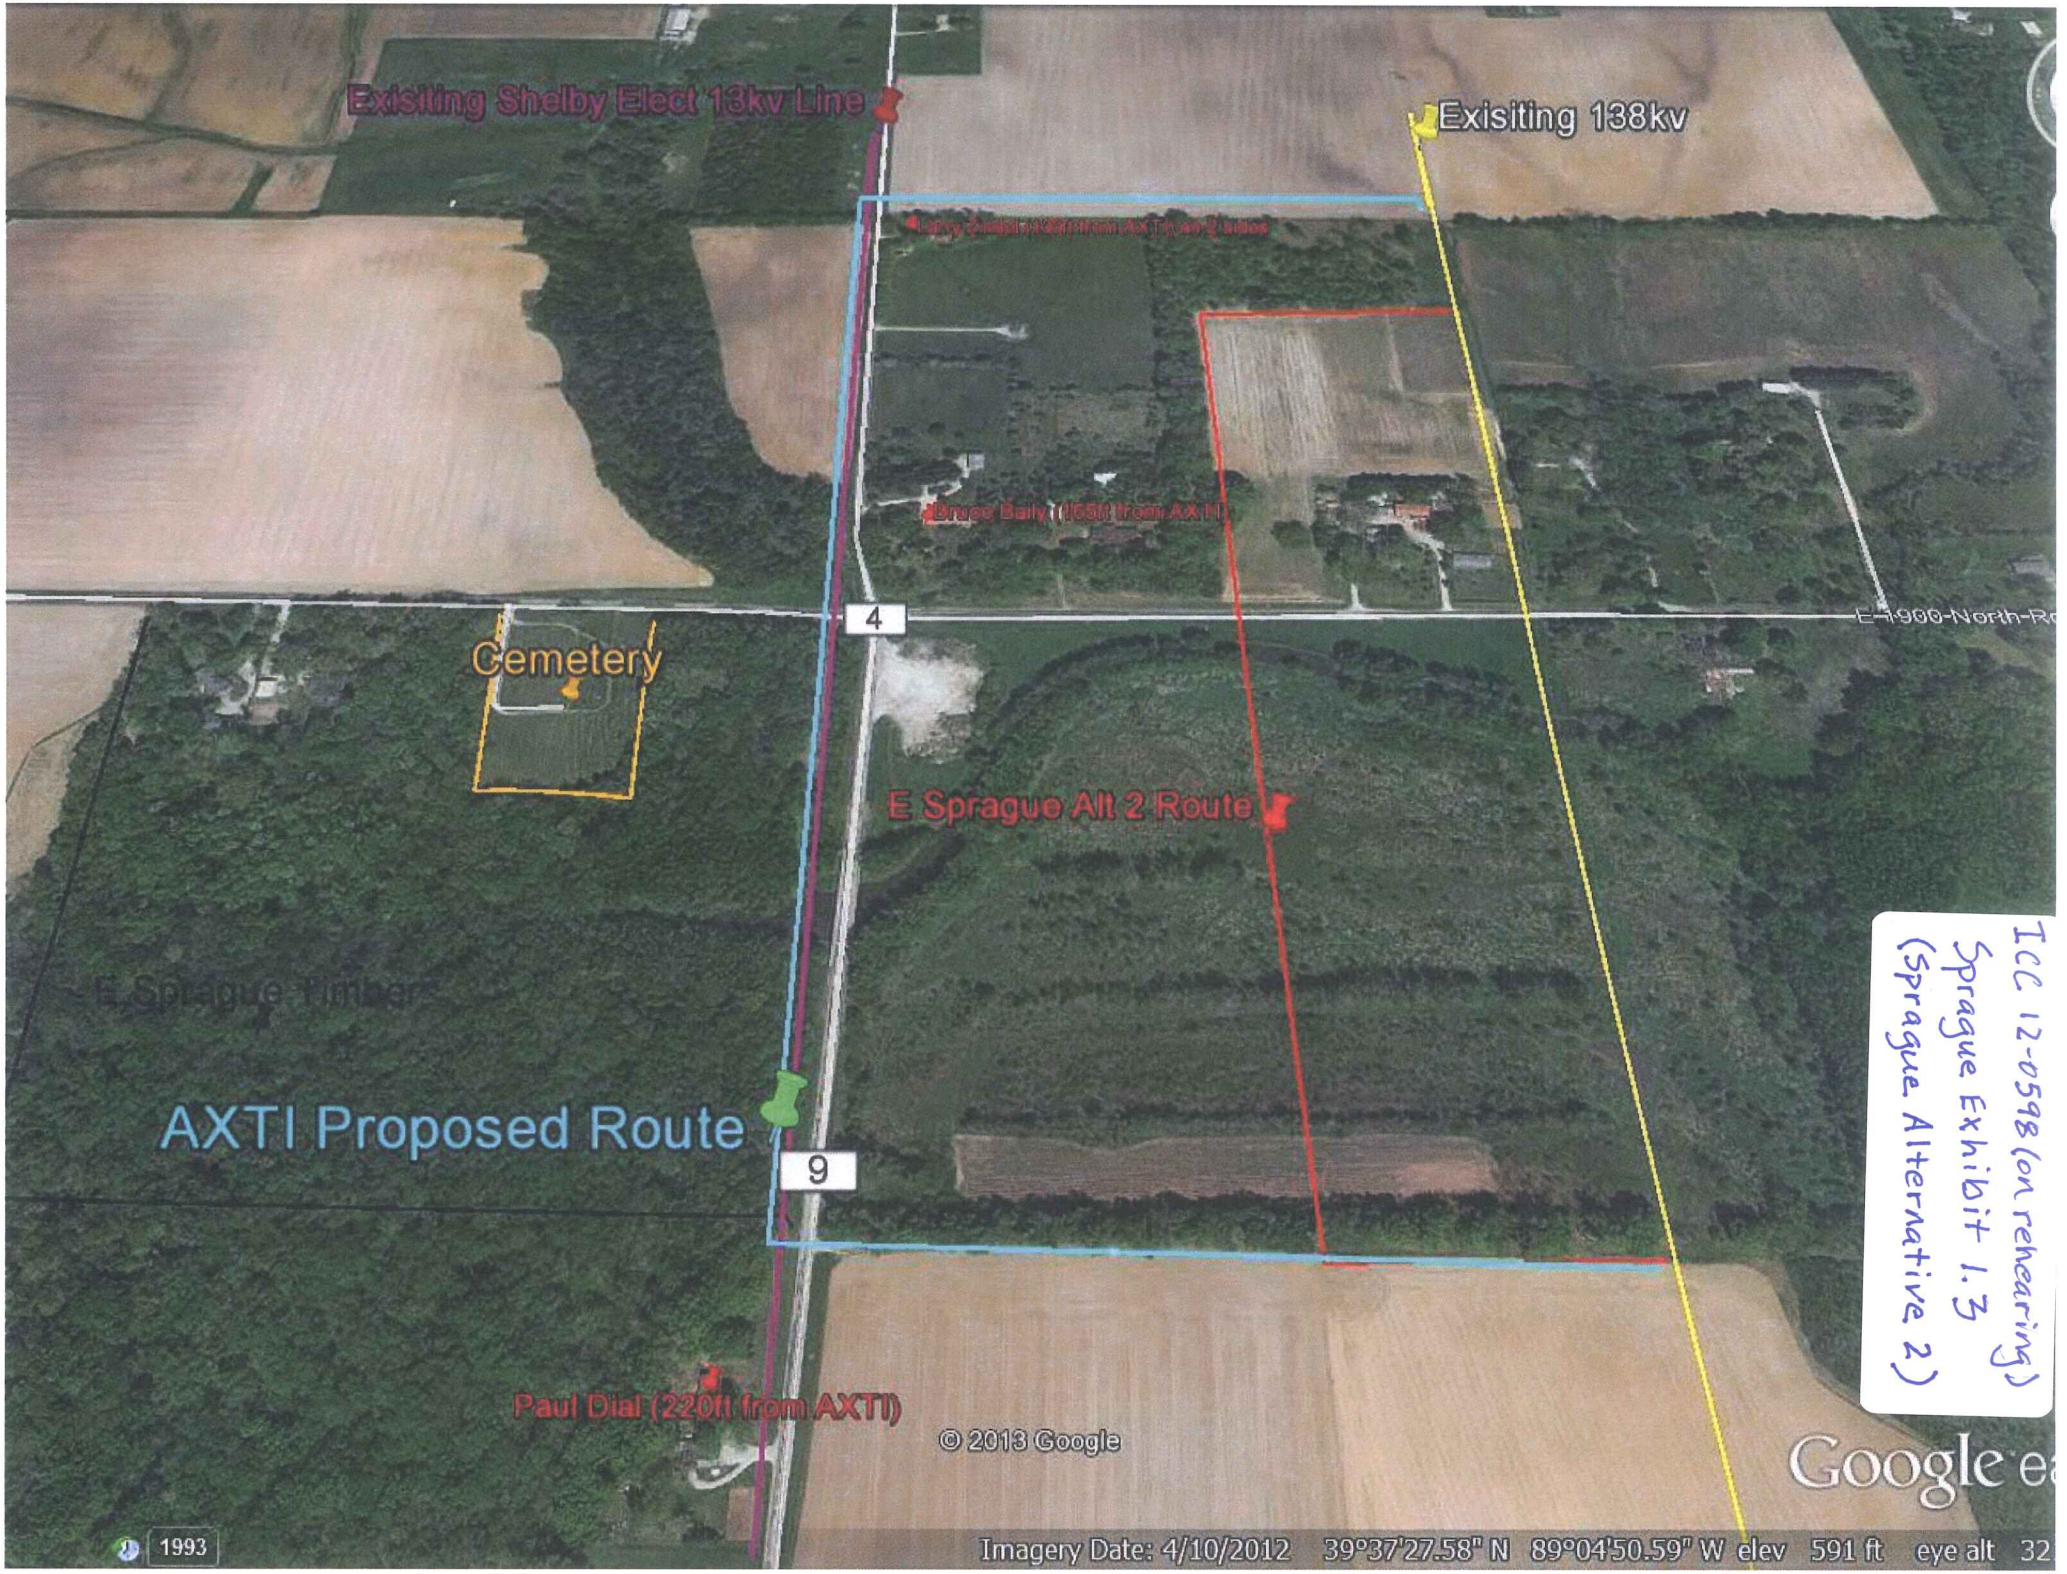
Existing Shelby Elect 13kv Line
Exisiting 138kv
Bruce Baily (165ft from AXTI)
4
Cemetery
E Sprague Alt 2 Route
E Sprague Timber
AXTI Proposed Route
9
Paul Dial (220ft from AXTI)
© 2013 Google
Google
1993
Imagery Date: 4/10/2012 39°37'27.58" N 89°04'50.59" W elev 591 ft eye alt 32
ICC 12-0598 (on rehearing)
Sprague Exhibit 1.3
(Sprague Alternative 2)

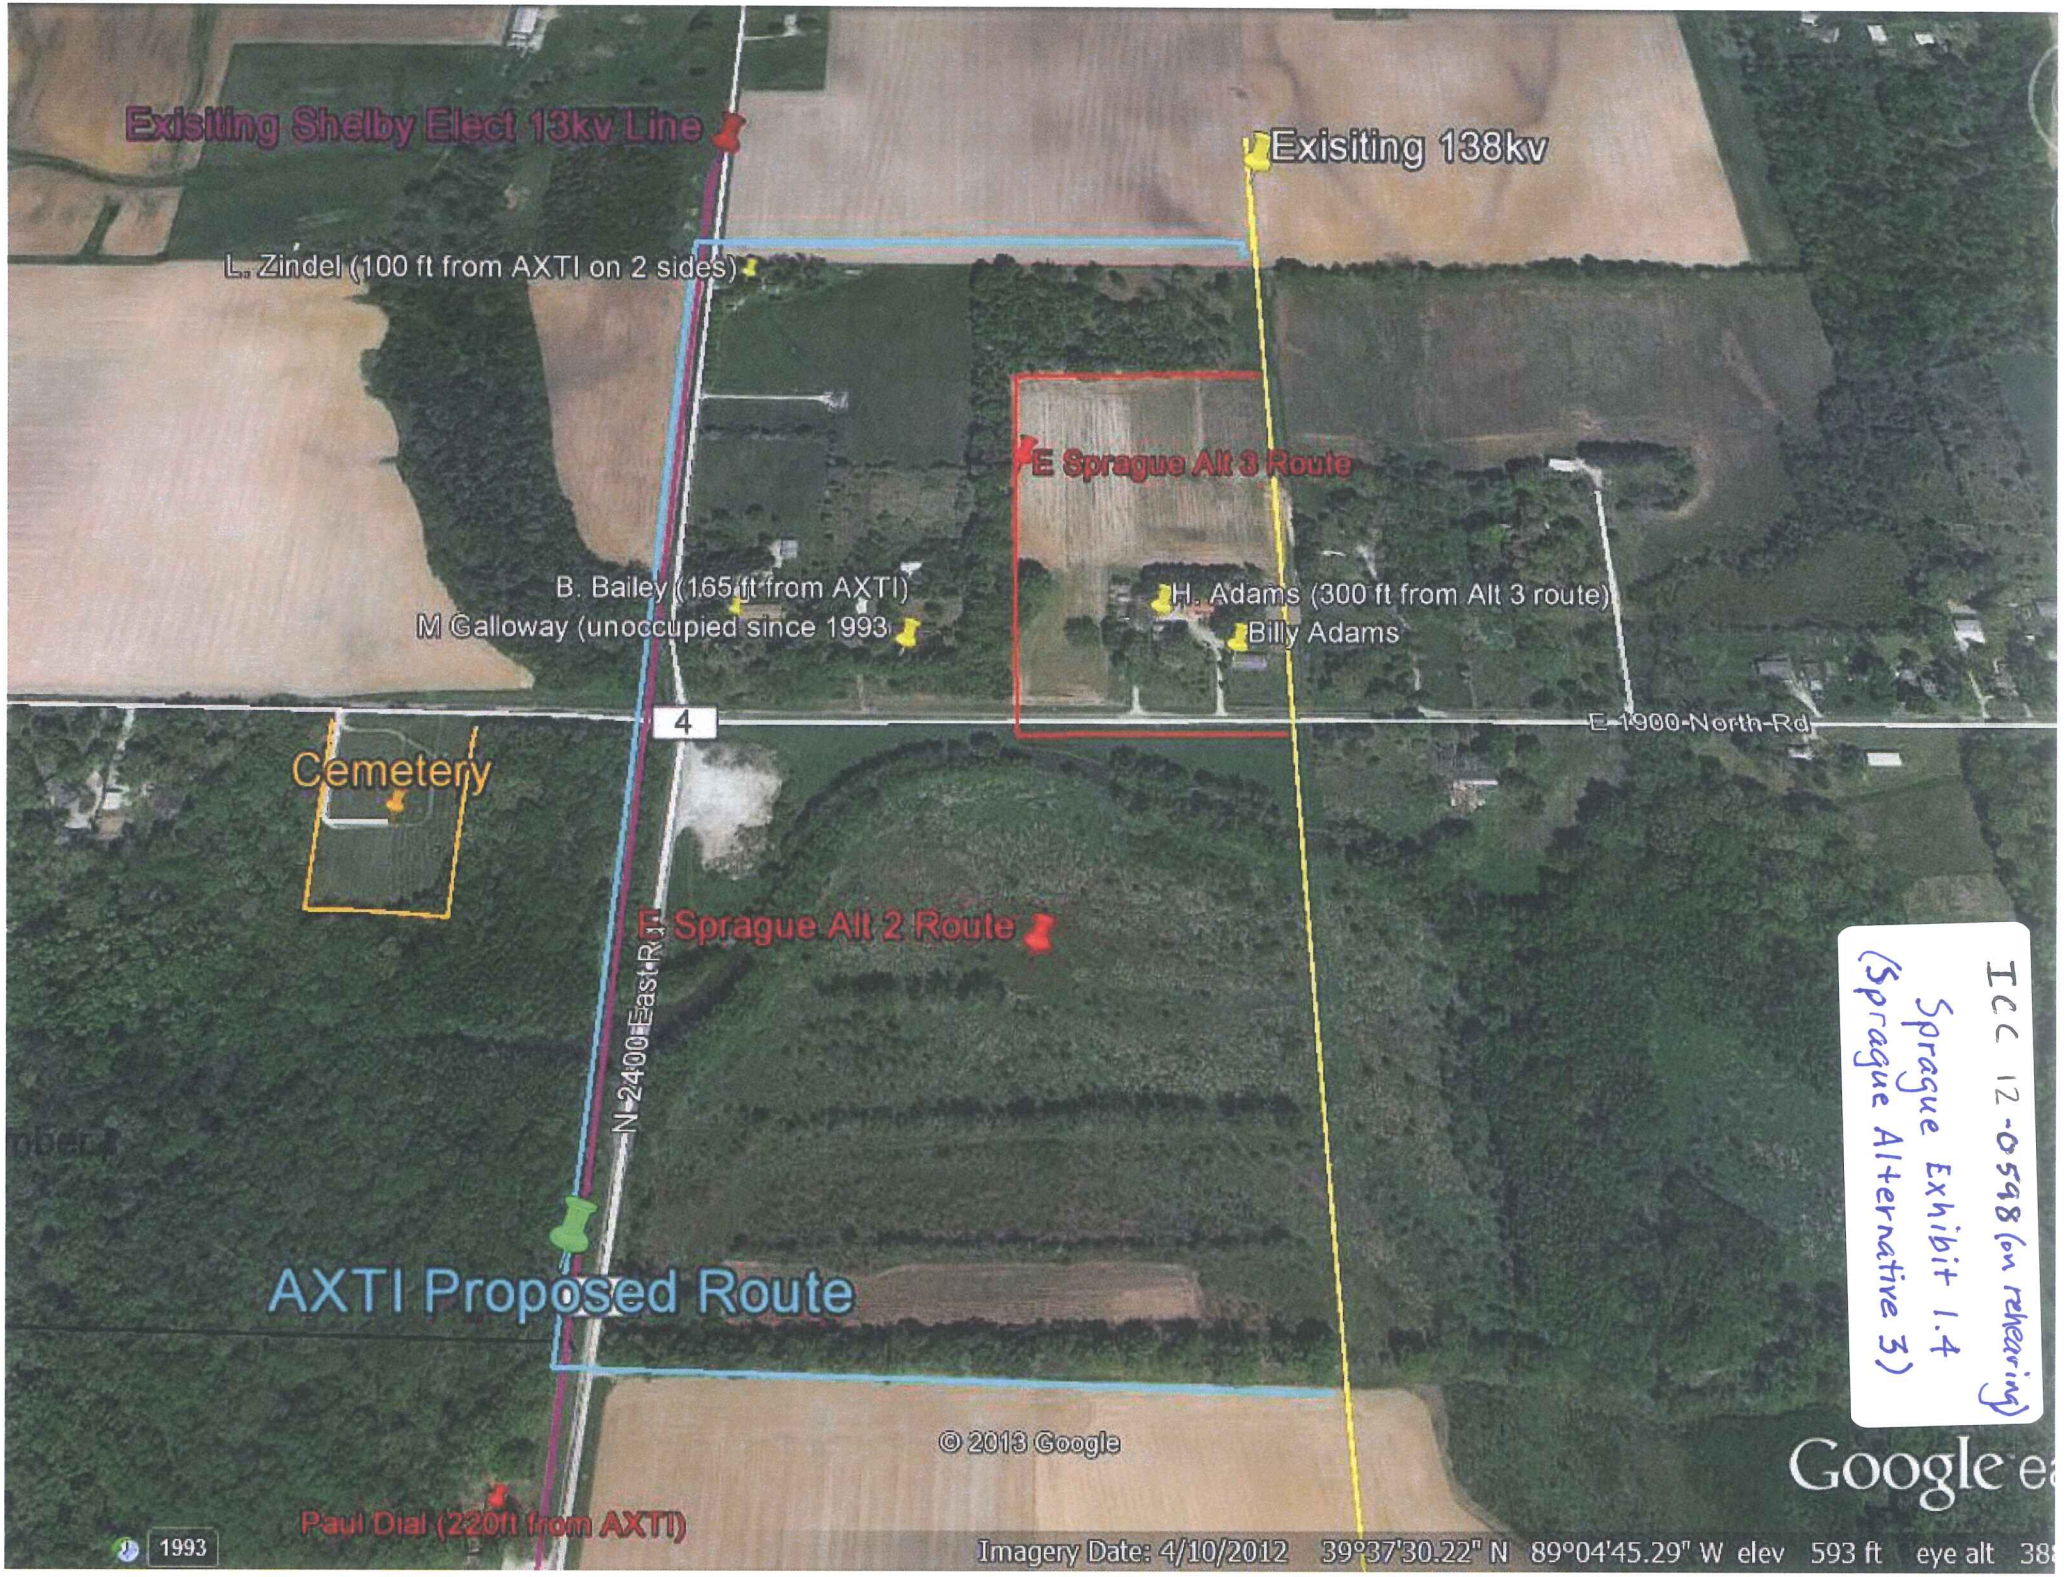
Existing Shelby Elect 13kv Line
Exisiting 138kv
L. Zindel (100 ft from AXTI on 2 sides)
E Sprague Alt 3 Route
B. Bailey (165 ft from AXTI)
M Galloway (unoccupied since 1993
H. Adams (300 ft from Alt 3 route)
Billy Adams
4
E 1900 North Rd
Cemetery
E Sprague Alt 2 Route
N 2400 East Rd
AXTI Proposed Route
© 2013 Google
Paul Dial (220ft from AXTI)
1993
Imagery Date: 4/10/2012 39°37'30.22" N 89°04'45.29" W elev 593 ft eye alt
ICC 12-0598 (on rehearing)
Sprague Exhibit 1.4
(Sprague Alternative 3)

Sprague Exhibit 1.5

Description	*Proposed Route AXTI*	*Proposed Route E.Sprague Alt 1*	*Proposed Route E.Sprague Alt 2*	*Proposed Route E.Sprague Alt 3*
Houses (Occupied) Impacted:	3	1	0	0
Cemetery Impacted:	1	0	0	0
Linear feet of Timber impacted:	1,765 ft	0	425 ft	0
Closest Distance to Houses (Occupied):	100 ft	75 ft	290 ft	290 ft
Interference to non-AMEREN power line:	1	0	0	0
Add'l High Voltage Power Line Requried	2,770 ft	0	1,080 ft	1,080 ft

ICC 12-0598 (on rehearing)
Sprague Exhibit 1.5