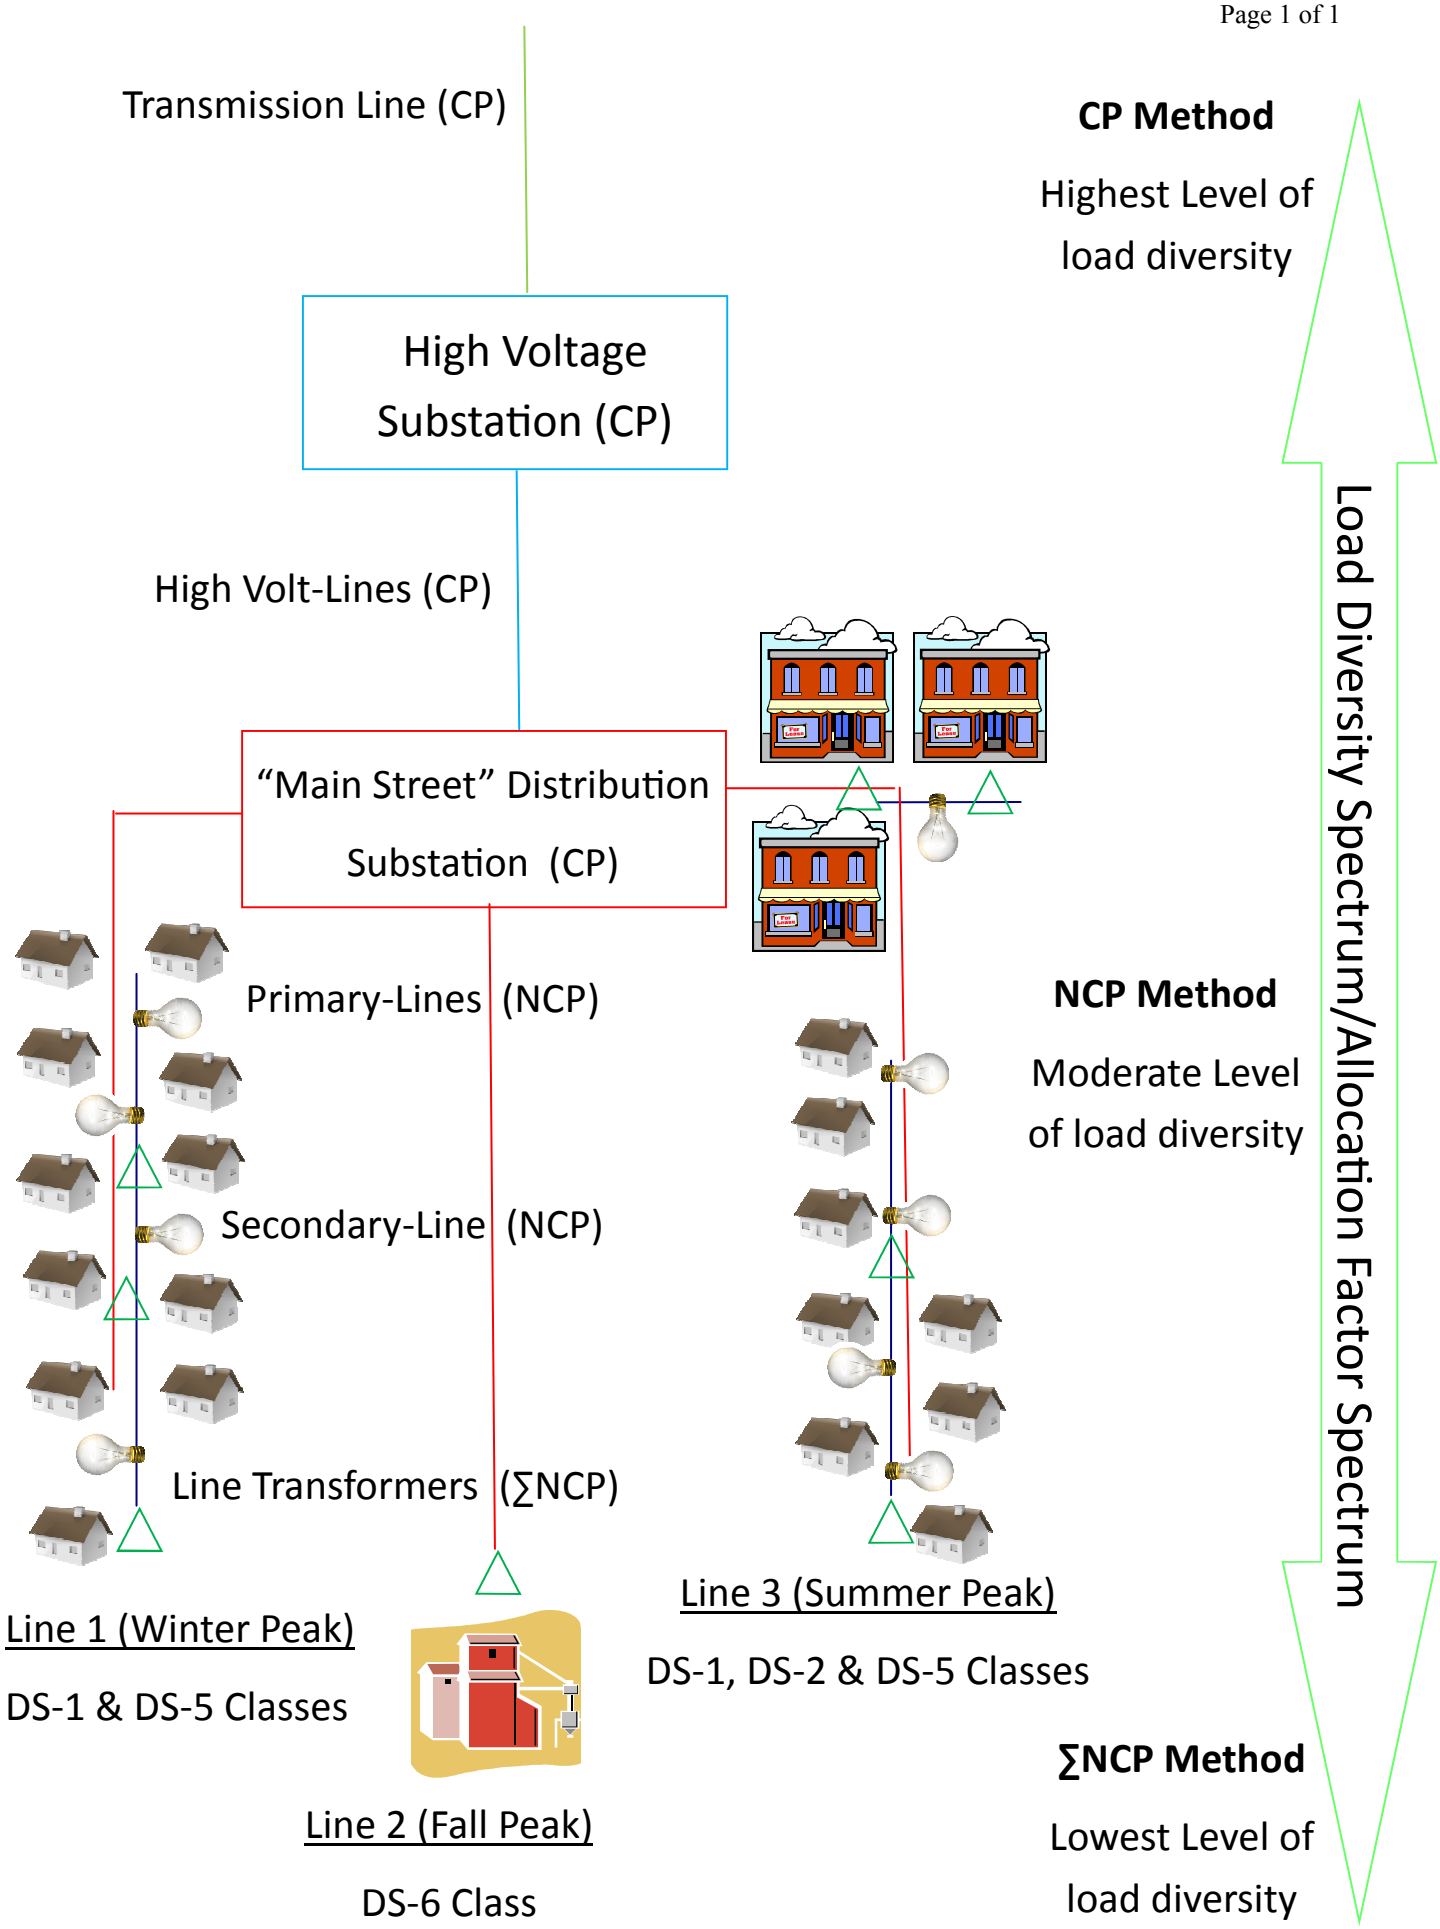
Transmission Line (CP)
CP Method
Highest Level of load diversity
High Voltage Substation (CP)
High Volt-Lines (CP)
"Main Street" Distribution Substation (CP)
Primary-Lines (NCP)
NCP Method
Moderate Level of load diversity
Secondary-Line (NCP)
Line Transformers (∑NCP)
Line 1 (Winter Peak)
DS-1 & DS-5 Classes
Line 3 (Summer Peak)
DS-1, DS-2 & DS-5 Classes
Line 2 (Fall Peak)
DS-6 Class
∑NCP Method
Lowest Level of load diversity
Load Diversity Spectrum/Allocation Factor Spectrum