
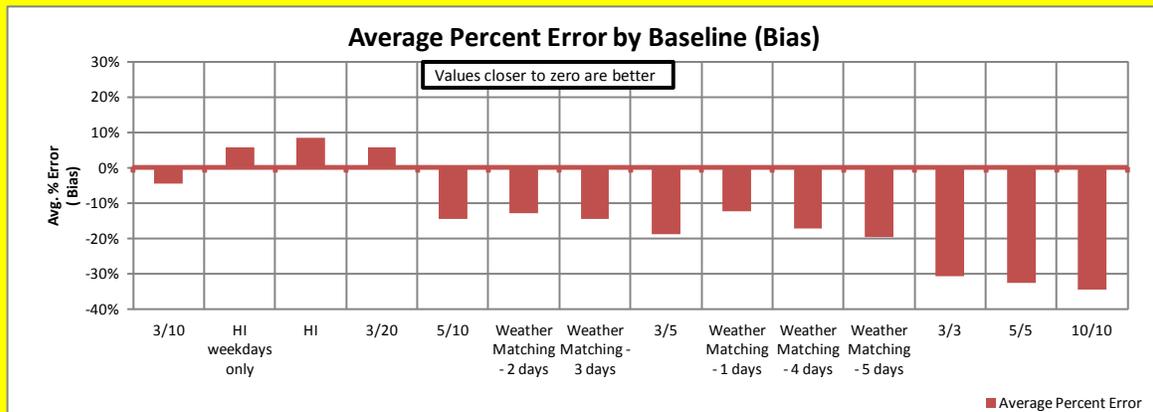


Commonwealth Edison Company
Analysis Results of Alternative Customer Baseline Methodologies

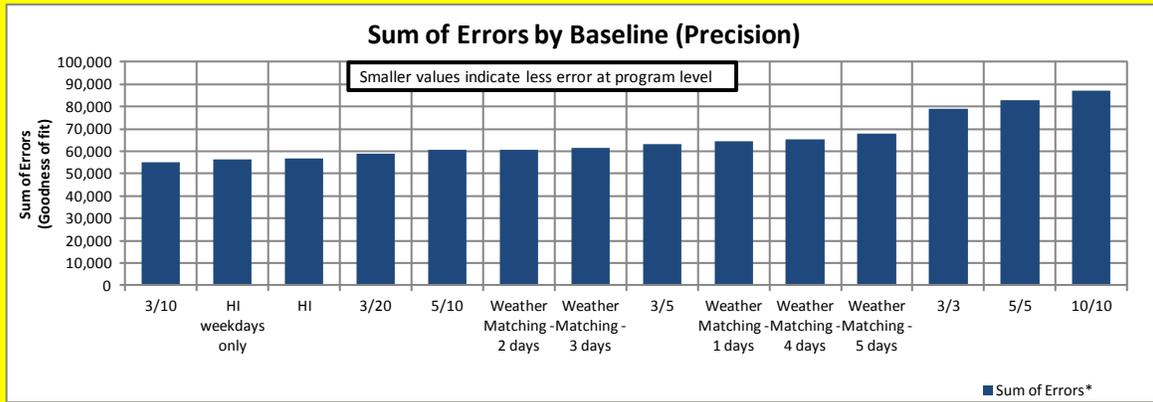

- Most Customer Baseline (“CBL”) methodologies exhibit a tendency to over or under estimate CBL (bias).
- The 3-in-10 CBL methodology has the most precision and smallest bias.
- On average, it underestimates the load reduction by about 5%.
- The HI weekdays only methodology has the second most precision and bias.
- On average, it overestimates the load reduction by about 6%.