

**STATE OF ILLINOIS
ILLINOIS COMMERCE COMMISSION**

In the Matter of the Application of)
Illinois-American Water Company for a)
Certificate of Public Convenience and)
Necessity to Provide Water and Sanitary) Case No. 14-_____
Sewer Service to Certain Areas in DuPage)
County, Illinois, pursuant to Section)
8-406(e) of the Illinois Public Utilities Act)

**APPLICATION FOR CERTIFICATE
OF PUBLIC CONVENIENCE AND NECESSITY**

TO THE ILLINOIS COMMERCE COMMISSION, SPRINGFIELD, ILLINOIS:

Illinois-American Water Company (“IAWC”) hereby requests that the Illinois Commerce Commission enter an order pursuant to Section 8-406 of the Illinois Public Utilities Act, 220 ILCS 5/ (the “Act”), issuing a Certificate of Public Convenience and Necessity to IAWC for two areas in DuPage County, Illinois in order to provide water and sanitary sewer service to two areas contiguous to IAWC’s current Certificate of Convenience and Public Necessity, at the request of two property owners seeking public water and sanitary sewer service from IAWC. In support of its Application, IAWC states:

1. IAWC is a company duly incorporated under the laws of the State of Illinois, and is duly authorized to do business in the State of Illinois. IAWC is a public utility within the meaning of the Act, and is now engaged in the business of furnishing potable water and sanitary sewer service to the customers in the State of Illinois.

2. The post office address of IAWC is 300 North Water Works Drive, Belleville, Illinois 62223.

3. IAWC provides water and/or sanitary sewer service in several counties in Illinois, including potable water and sewer service in DuPage County.

4. IAWC's current certificated area of service in DuPage County was approved by the Commission in a number of dockets, the most recent of which was Docket No. 08-0542 (IAWC's current certificated area of service in the DuPage County region will be referred to hereafter as the "Current Certificate".)

5. IAWC seeks authority to provide service to two new areas that are contiguous to areas served within its Current Certificate. The proposed areas for which certification is requested are: an area in IAWC's DuPage service district seeking both water and sanitary sewer service (as set forth on the map and legal description attached hereto as Exhibit A) and an area in IAWC's Valley View service district seeking water service (as set forth on the map and legal description attached hereto as Exhibit B).

6. IAWC has been requested to provide service by the owner of the property in each new service area. The request by the property owner in the DuPage area is attached as Exhibit C, and the request by the property owner in the Valley View area is attached as Exhibit D.

7. The two properties in the Expanded Certificate are not currently served by any other water service or sanitary sewer provider. Therefore, no municipality, water or sewer utility or other entity currently serves or is able to serve the Expanded Certificate area.

8. The municipalities whose corporate boundaries lie within one and one-half miles of the proposed Expanded Certificate area are the municipalities of Naperville, Lisle, and Downers Grove (for the proposed new area in IAWC's DuPage service district), and Glen Ellyn and Lombard (for the proposed new area in IAWC's Valley View service district), and a copy of

this application is being mailed to those municipalities as required by 83 Ill. Admin. Code 200.150(b).

9. IAWC plans to charge all customers within the proposed Expanded Certificate area the rates that are in effect for IAWC's Zone 1 district. Such customers will be subject to IAWC's rules, regulations and conditions of service on file with the Commission.

10. The source for the water provided to the proposed Expanded Certificate is purchased water.

11. IAWC does not believe that any new easements are necessary at this time to provide service to the proposed Expanded Certificate area. However, if it becomes necessary at a later date to acquire easements, IAWC will comply with 83 Ill. Admin. Code Part 300.

12. IAWC is capable of efficiently managing and supervising the provision of water service and sewer service to the proposed Expanded Certificate area. IAWC is capable of financing any new construction in the proposed Expanded Certificate area without significant adverse financial consequences to IAWC or its customers, although no new construction will be performed by IAWC in connection with the proposed Expanded Certificate area. IAWC's provision of water and sewer service in the proposed Expanded Certificate area will promote the public convenience and is necessary thereto, and the interest of the public will be served thereby.

WHEREFORE, IAWC requests that the Commission grant IAWC's application and issue a Certificate of Public Convenience and Necessity authorizing IAWC to own, operate, and maintain the facilities necessary and appropriate to serve the areas in DuPage County as shown and legally described in Exhibits A and B and that the Commission grant such further relief as may be just, reasonable and proper.

Respectfully submitted,

ILLINOIS-AMERICAN WATER COMPANY

By: /s/ Kenneth C. Jones

Kenneth C. Jones
Vice President-Legal
300 N. Water Works Drive
Belleville, IL 62223
kenneth.jones@amwater.com
(618) 239-3222 (telephone)
(618) 236-1186 (telefax)

STATE OF ILLINOIS)
)
COUNTY OF DUPAGE)

Verification

Richard A. Hermann, Engineering Manager-Northern Illinois, for Illinois-American Water Company, being first duly sworn, deposes and states that he is familiar with the facts stated in the Application for Certificate of Public Convenience and Necessity of Illinois-American Water Company and that said facts are true and correct to the best of his knowledge, information and belief.




Richard A. Hermann

Subscribed and sworn to before me this 29 day of August, 2014.




Notary Public



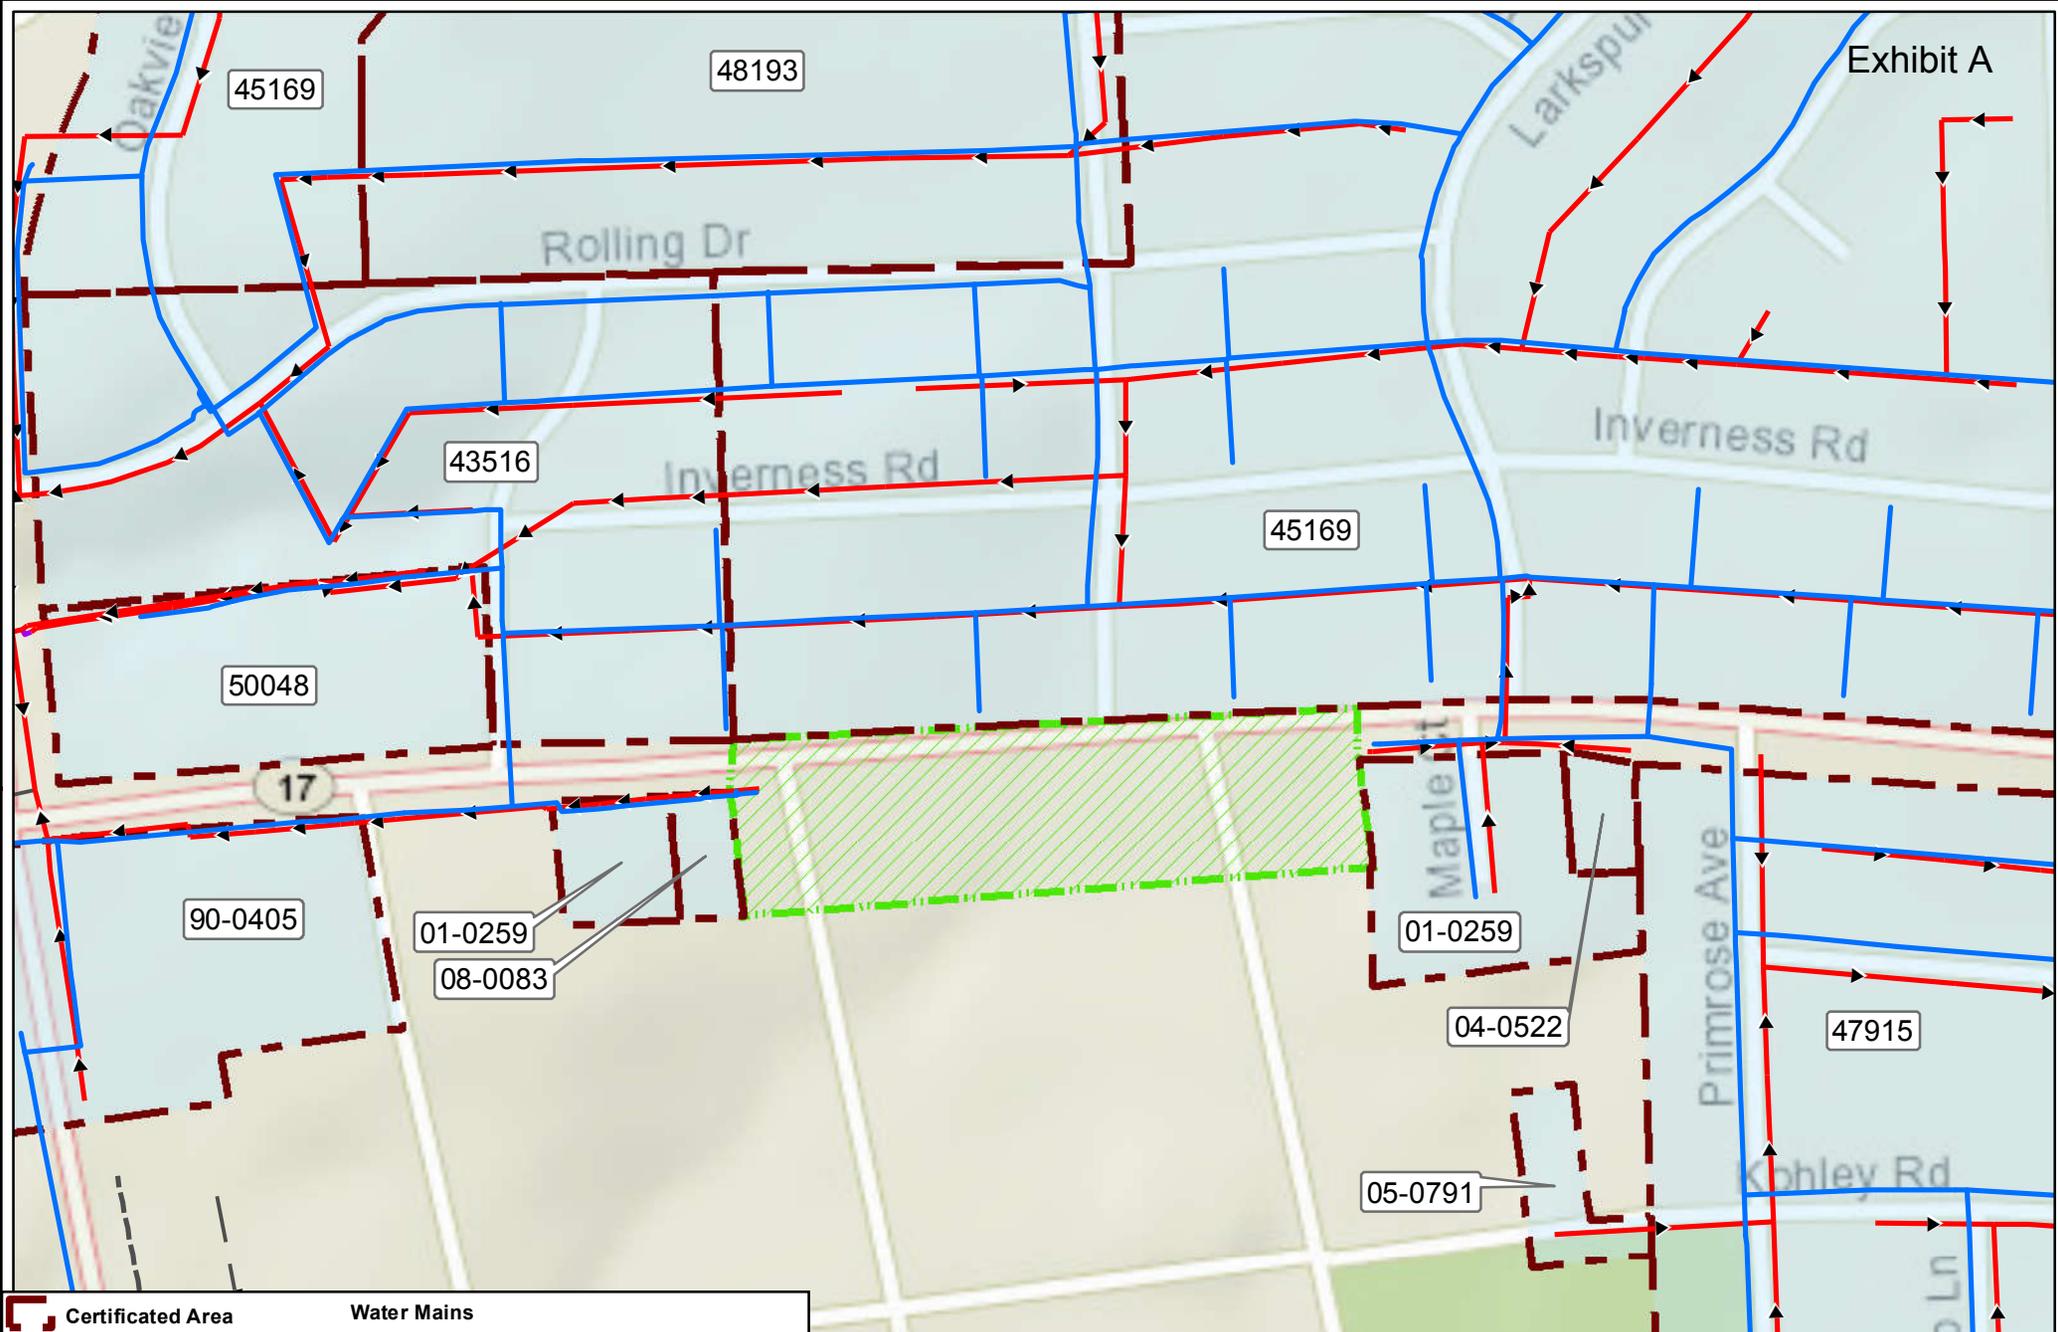

	Certificated Area		Water Mains
	Proposed Certificated Area		Potable Distribution
	System Interconnect		Raw Water
	Elevated Tank		Owned & Operated by Others
	Pumping Station		Sanitary Mains
			Gravity Collector
			Collector Owned & Operated by Others
			Force Main

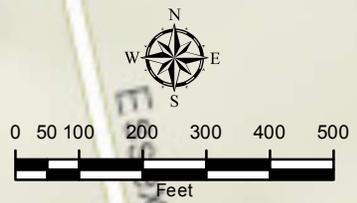


PROPOSED CERTIFICATED AREA EXHIBIT
 CHICAGO METRO DISTRICT
 DU PAGE SERVICE AREA
 DU PAGE COUNTY, ILLINOIS



DUPAGE CERTIFICATED AREA

THAT PART OF THE SOUTHWEST QUARTER OF SECTION 11, TOWNSHIP 38 NORTH, RANGE 10 EAST OF THE THIRD PRINCIPAL MERIDIAN, DESCRIBED AS FOLLOWS: BEGINNING AT THE SOUTHWEST CORNER OF LOT 11 IN BLOCK 13 IN ARTHUR T. McINTOSH AND COMPANY'S LISLE FARMS, BEING A SUBDIVISION OF LOTS 2 TO 12, INCLUSIVE, EXCEPT PARTS OF 10 AND 11 OF ASSESSMENT PLAT OF PARTS OF SECTIONS 10, 11, 14 AND 15, TOWNSHIP 38 NORTH, RANGE 10 EAST OF THE THIRD PRINCIPAL MERIDIAN, ACCORDING TO THE PLAT THEREOF RECORDED DECEMBER 31, 1924, AS DOCUMENT 186704; THENCE NORTH 7°18'50" WEST 182.54 FEET, ALONG THE WEST LINE OF SAID LOT 11, TO A LINE 17.00 FEET SOUTH OF AND PARALLEL WITH THE NORTH LINE OF SAID LOT 11; THENCE NORTH 86°42'11" EAST, ALONG SAID PARALLEL LINE, BEING ALSO 17.00 FEET SOUTH OF AND PARALLEL WITH THE NORTH LINES OF BLOCKS 14 AND 19 IN SAID ARTHUR T. McINTOSH AND COMPANY'S LISLE FARMS, 995.92 FEET TO A POINT THAT IS 30.38 FEET EAST (AS MEASURED ALONG SAID PARALLEL LINE) OF THE WEST LINE OF LOT 4 IN SAID BLOCK 19; THENCE NORTH 3°17'49" WEST 8.49 FEET; THENCE NORTH 86°42'11" EAST 16.92 FEET; THENCE SOUTH 3°17'49" EAST 8.49 FEET TO AFORESAID PARALLEL LINE; THENCE NORTH 86°42'11" EAST, ALONG SAID PARALLEL LINE, 16.92 FEET TO THE WEST LINE OF THE EASTERLY 40.70 FEET OF LOT 5 IN SAID BLOCK 19; THENCE SOUTH 7°18'50" EAST, ALONG SAID WEST LINE, 182.84 FEET TO THE SOUTH LINE OF SAID LOT 5; THENCE SOUTH 86°42'11" WEST 1024.84 FEET, ALONG THE SOUTH LINE OF LOTS 1 TO 5, INCLUSIVE, IN SAID BLOCK 19 AND ALONG THE SOUTH LINE OF LOTS 1 TO 11, INCLUSIVE, IN SAID BLOCK 14 AND ALONG THE SOUTH LINE OF LOT 11 IN SAID BLOCK 13, TO THE POINT OF BEGINNING; IN DUPAGE COUNTY, ILLINOIS.

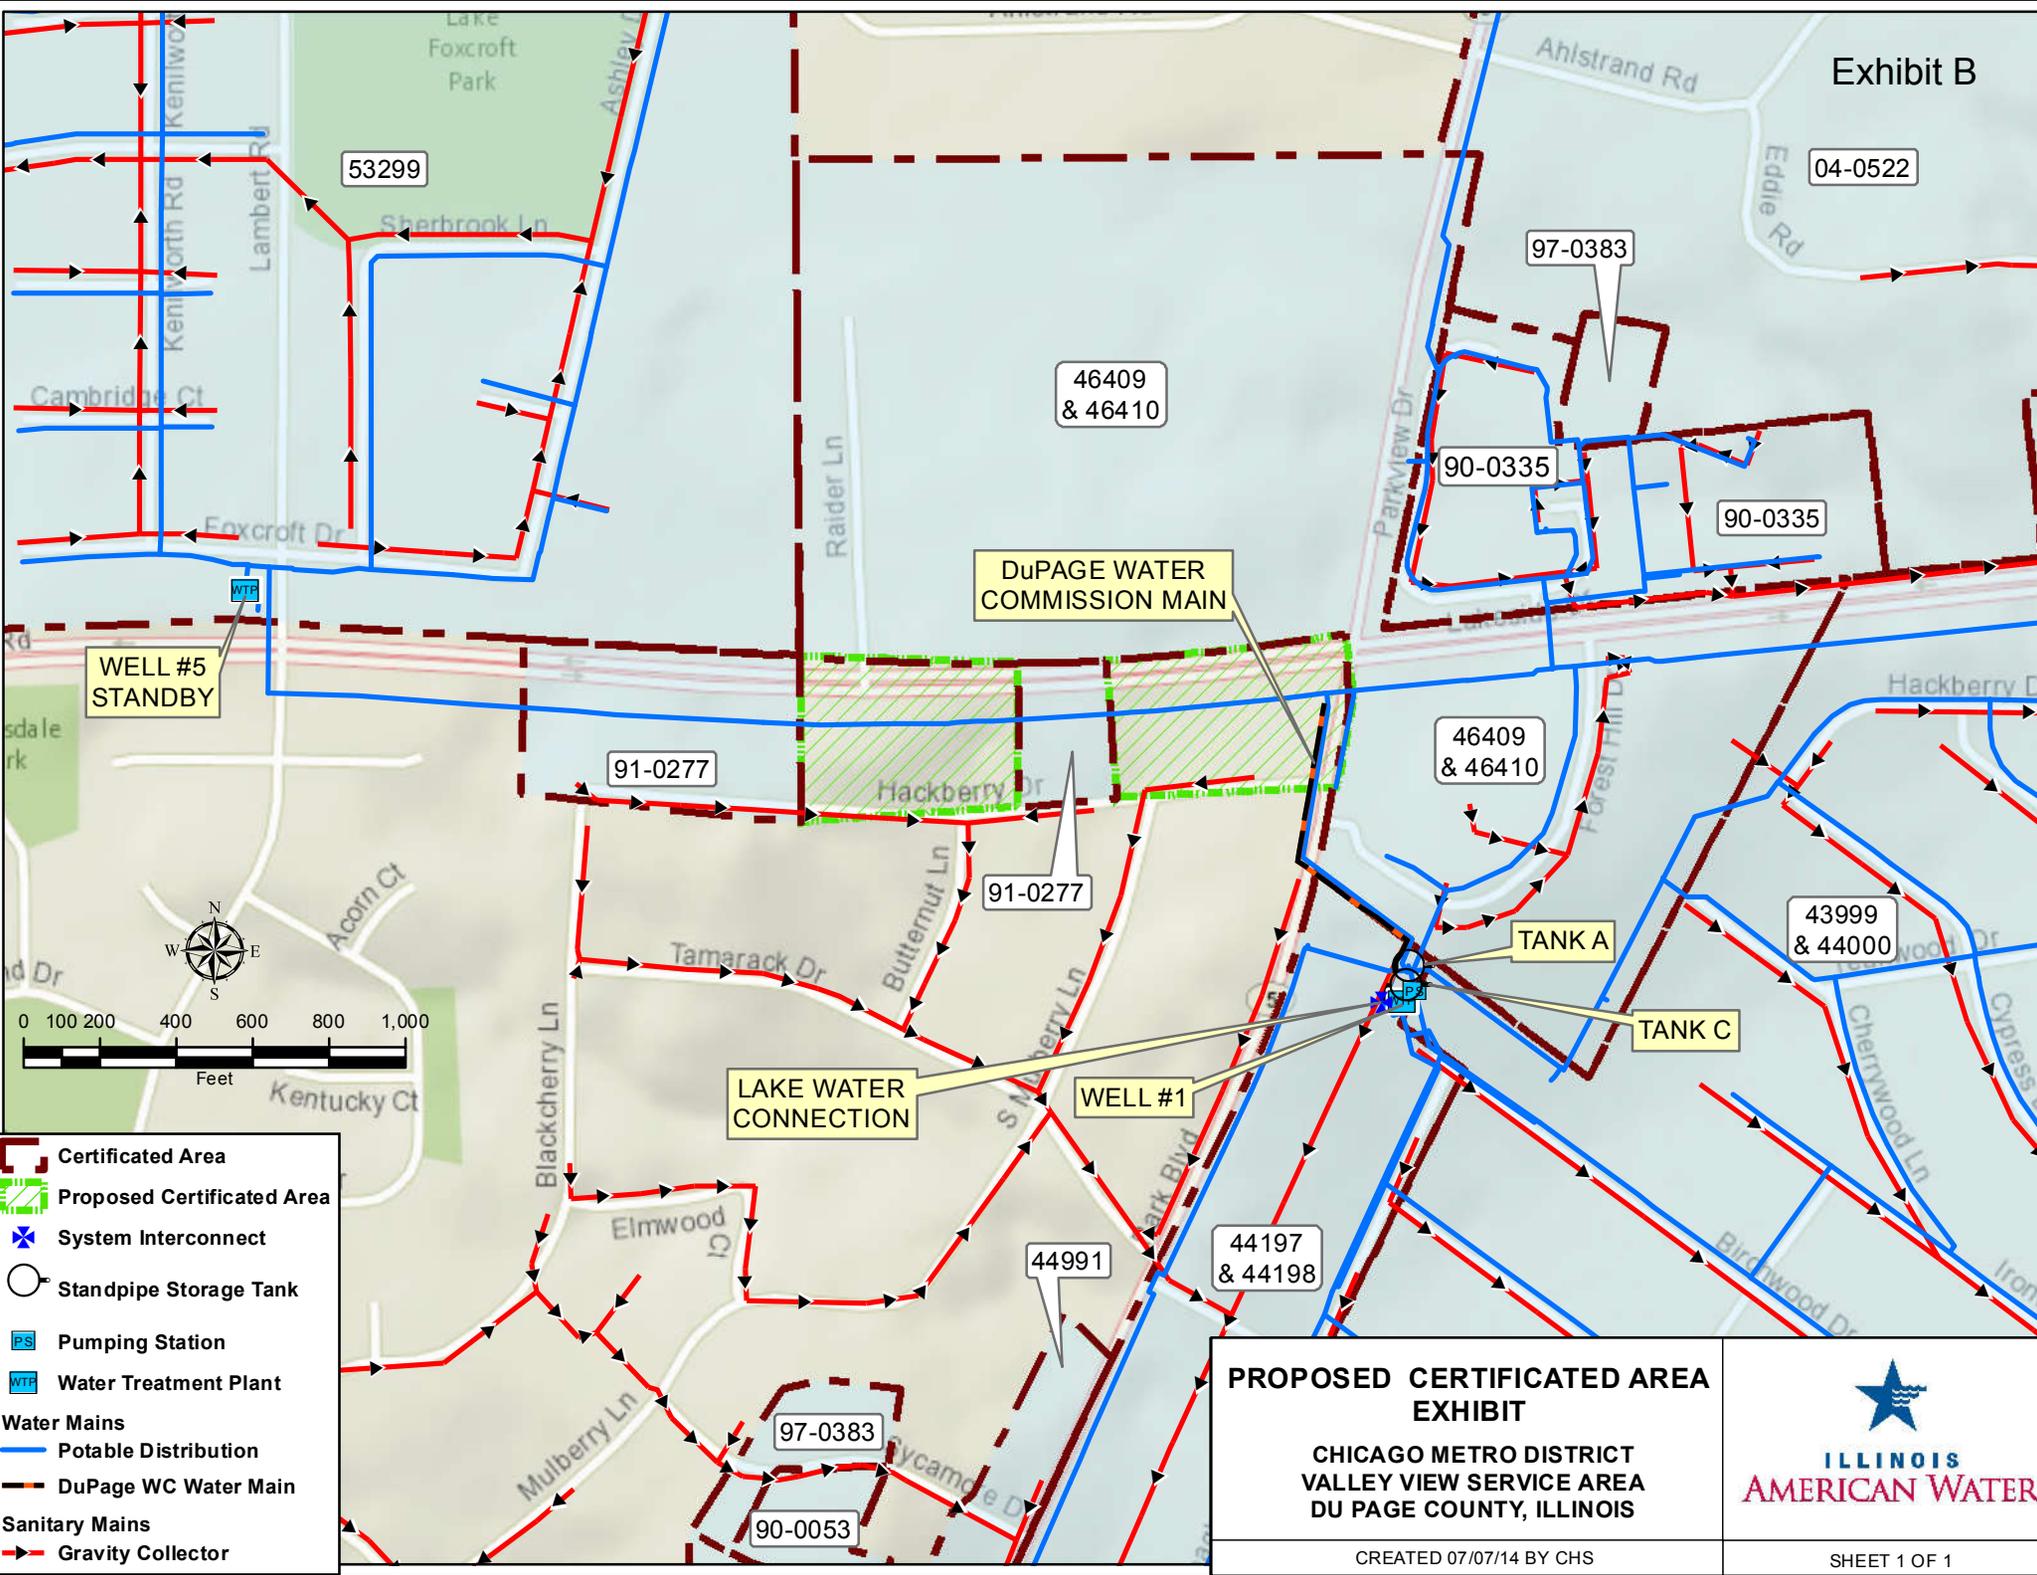

- Certified Area
- Proposed Certified Area
- System Interconnect
- Standpipe Storage Tank
- Pumping Station
- Water Treatment Plant
- Water Mains**
- Potable Distribution
- DuPage WC Water Main
- Sanitary Mains**
- Gravity Collector

PROPOSED CERTIFICATED AREA EXHIBIT

CHICAGO METRO DISTRICT
 VALLEY VIEW SERVICE AREA
 DU PAGE COUNTY, ILLINOIS



VALLEY VIEW CERTIFICATED AREAS

EAST AREA

THAT PART OF BLOCK 1 IN ARTHUR T. McINTOSH & CO.'S GLEN ELLYN WOODS UNIT NO. 2, BEING A SUBDIVISION IN SECTIONS 34 AND 35, TOWNSHIP 39 NORTH, RANGE 10 EAST OF THE THIRD PRINCIPAL MERIDIAN, ACCORDING TO THE PLAT THEREOF RECORDED APRIL 21, 1955, AS DOCUMENT 753863, AND CERTIFICATE OF CORRECTION FILED NOVEMBER 21, 1961, AS DOCUMENT R61-31111, DESCRIBED AS FOLLOWS: BEGINNING AT THE NORTHWEST CORNER OF LOT 6 IN SAID BLOCK 1; THENCE EASTERLY, ALONG THE NORTH LINE OF LOTS 6, 5, 4 AND 3 IN SAID BLOCK 1, BEING A CURVE CONVEX TO THE SOUTH AND HAVING A CALCULATED RADIUS OF 8734.58 FEET AND A 313.12 FOOT CHORD BEARING NORTH 87°07'07" EAST, AN ARC DISTANCE OF 313.14 FEET TO A POINT OF TANGENCY; THENCE NORTH 86°05'30" EAST 315.53 FEET, ALONG THE NORTH LINE OF LOTS 3, 2 AND 1 IN SAID BLOCK 1, TO THE NORTHEAST CORNER OF SAID LOT 1; THENCE SOUTH 12°40'30" WEST 187.80 FEET, ALONG THE EAST LINE OF SAID LOT 1, TO THE SOUTHEAST CORNER OF SAID LOT 1; THENCE SOUTH 86°05'30" WEST 575.00 FEET, ALONG THE SOUTH LINE OF LOTS 1, 2, 3, 4, 5 AND 6 IN SAID BLOCK 1, TO THE SOUTHWEST CORNER OF SAID LOT 6; THENCE NORTH 3°54'30" WEST 185.60 FEET, ALONG THE WEST LINE OF SAID LOT 6, TO THE POINT OF BEGINNING; IN DUPAGE COUNTY, ILLINOIS.

WEST AREA

THAT PART OF BLOCK 1 IN ARTHUR T. McINTOSH & CO.'S GLEN ELLYN WOODS UNIT NO. 2, BEING A SUBDIVISION IN SECTIONS 34 AND 35, TOWNSHIP 39 NORTH, RANGE 10 EAST OF THE THIRD PRINCIPAL MERIDIAN, ACCORDING TO THE PLAT THEREOF RECORDED APRIL 21, 1955, AS DOCUMENT 753863, AND CERTIFICATE OF CORRECTION FILED NOVEMBER 21, 1961, AS DOCUMENT R61-31111, DESCRIBED AS FOLLOWS: BEGINNING AT THE SOUTHWEST CORNER OF LOT 15 IN SAID BLOCK 1; THENCE NORTH 4°03'12" WEST 173.20 FEET, MORE OR LESS, ALONG THE WEST LINE OF SAID LOT 15, TO THE NORTHWEST CORNER OF SAID LOT 15; THENCE EASTERLY, ALONG THE NORTH LINE OF LOTS 15, 14, 13, 12, 11, 10 AND 9 IN SAID BLOCK 1, BEING A CURVE CONVEX TO THE SOUTH AND HAVING A CALCULATED RADIUS OF 8734.58 FEET AND A 614.15 FOOT CHORD BEARING SOUTH 88°11'51" EAST, AN ARC DISTANCE OF 614.27 FEET TO THE NORTHWEST CORNER OF THE EAST HALF OF SAID LOT 9; THENCE SOUTH 3°54'30" EAST, ALONG THE WEST LINE OF SAID EAST HALF, 198.16 FEET TO THE SOUTH LINE OF SAID LOT 9; THENCE SOUTH 86°05'30" WEST 128.60 FEET, ALONG THE SOUTH LINE OF LOTS 9 AND 10 IN SAID BLOCK 1, TO A BEND POINT; THENCE NORTH 83°46'30" WEST 489.70 FEET, ALONG THE SOUTH LINE OF LOTS 10, 11, 12, 13, 14 AND 15 IN SAID BLOCK 1, TO THE POINT OF BEGINNING; IN DUPAGE COUNTY, ILLINOIS.

Exhibit C

Dear Mr. Raymond Fowler

I am Damodara N. Mundluru, Owner of residential land at 901 Maple Ave. Lisle, requesting you for new water and sewer services connection. As you suggested, please process my application with required IL. Department of commerce and others and get required certification and permissions to provide water and sewer to my place.

I appreciate your help in regarding this and please contact me for any details from me.

Thank you



7/1/2014

Damodara N. Mundluru

Service Request property address:

901 Maple Ave, Lisle, IL.

Residence Address: 4517 Kingston Ave, Lisle, IL.

Ph.: 630-974-1243

Cell: 630-532-8005

Email: damo@risingsoft.com

June 13, 2014

Mr. Raymond T. Fowler Jr.
New Business Supervisor
1000 Internationale Parkway
Woodridge, Il. 60517

Dear Mr. Fowler,

Please accept this letter as my petition for approval to service domestic water needs to 35010 Park Blvd, Glen Ellyn, a property I currently own. The property is currently serviced by well water, I would like to be eligible to purchase domestic water service from your organization.

Sincerely,

A handwritten signature in blue ink, appearing to read "George Pearah". The signature is written in a cursive, flowing style.

Dr. George Pearah