

ILLINOIS-AMERICAN WATER COMPANY

RESPONSE TO ILLINOIS COMMERCE COMMISSION


DATA REQUEST NUMBER WD 1.03

Person Responsible: Kelly A. Simpson  
Title: Engineering Manager  
Phone No.: 618-239-3261  
Date Received: August 14, 2002  
Docket No.: 02-0450

WD 1.03. Please provide a detailed distribution map(s) showing IAWC's existing water distribution mains and the route of the proposed main extension for the third location.

RESPONSE See attached map.

OFFICIAL FILE  
ILL. C. C. DOCKET NO. 02-0450  
IAWC  
Witness \_\_\_\_\_  
Date 9/25/02 Reporter Carl

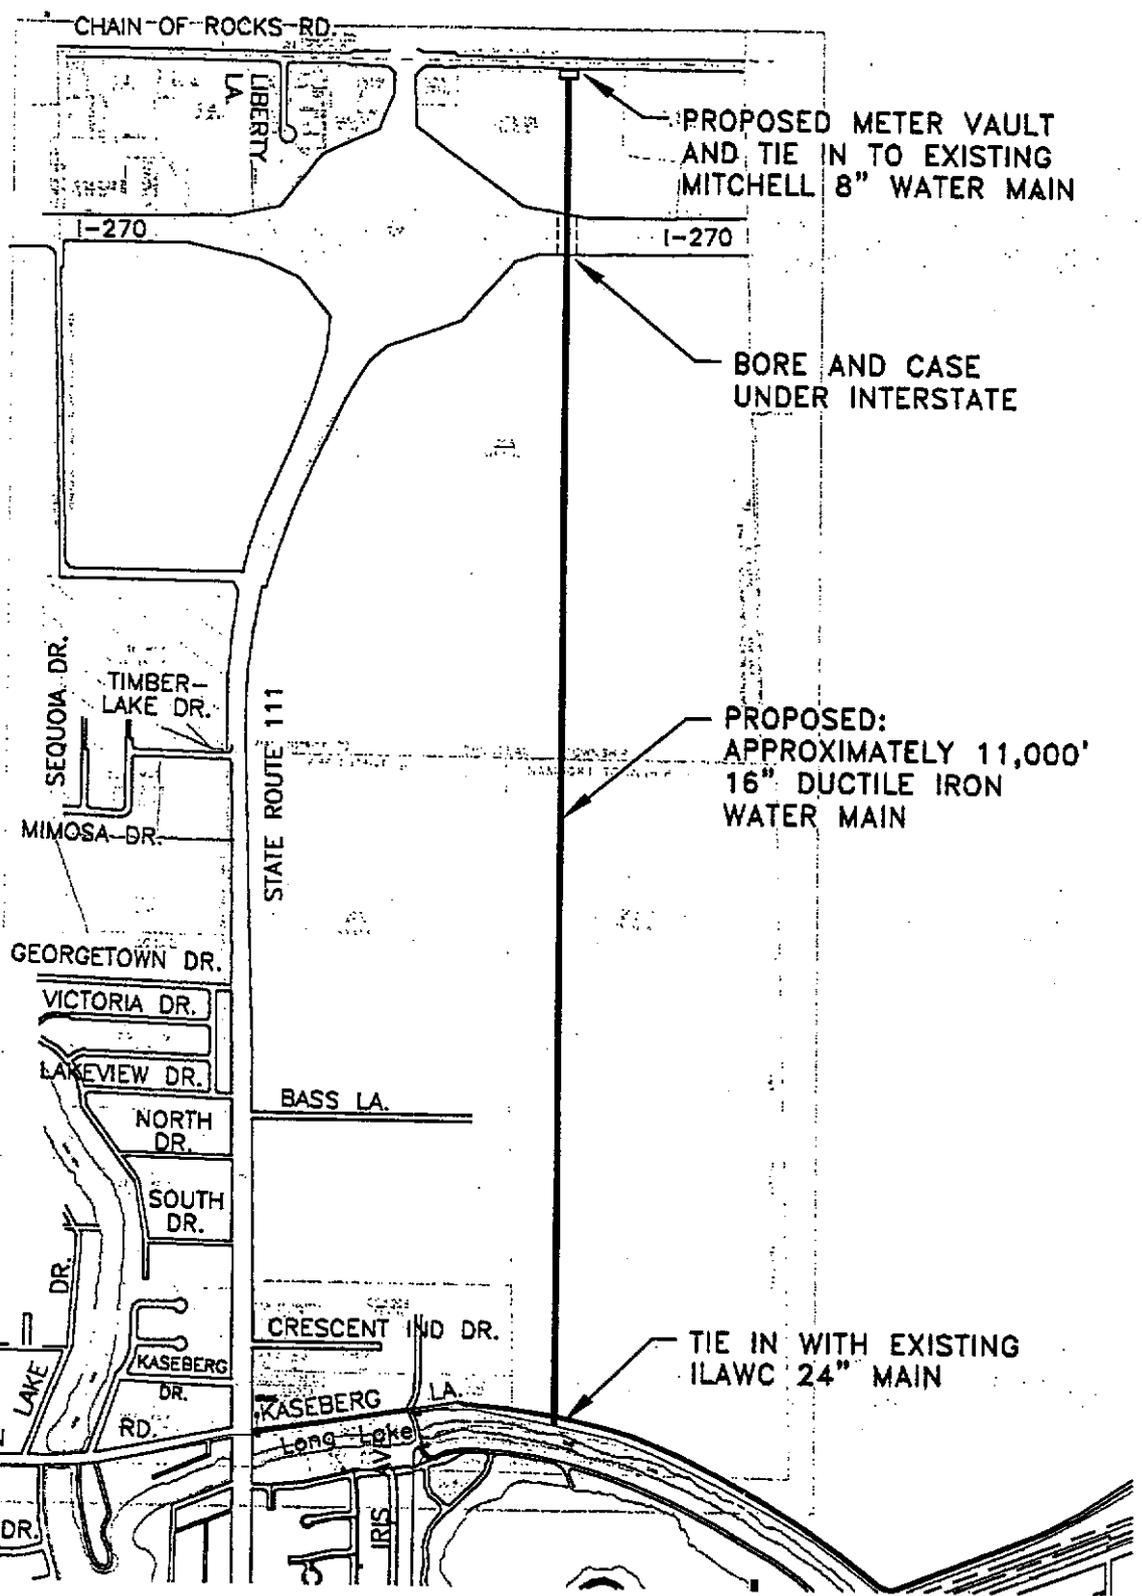

PROPOSED METER VAULT AND TIE IN TO EXISTING MITCHELL 8" WATER MAIN

BORE AND CASE UNDER INTERSTATE

PROPOSED: APPROXIMATELY 11,000' 16" DUCTILE IRON WATER MAIN

TIE IN WITH EXISTING ILAWC 24" MAIN

**LEGEND**

- PROPOSED: APPROXIMATELY 11,000' OF 16" WATER MAIN
- RIGHT-OF-WAY
- EXISTING IAWC WATER MAIN

PROPOSED: APPROXIMATELY 11,000' 16" DUCTILE IRON WATER MAIN - MITCHELL 3RD CONNECTION INTERURBAN DISTRICT



Illinois-American Water Company

SCALE: NONE DATE: AUGUST 2002