PAGE #: 1

REGION: City of Sterling	Illinois American (ILPR) Production Meter Test MTEST CUT-IN LANDLORD HICKSNM 1/29/03 10:43:09	SERVICE ORDER #: 89284
ROUTE/STOP: 170512 / 195		SERVICES PRINTED: 1 1
GRID/EXT: 043 /		REQUESTED BY: GARY SWART

UTILITY TYPE:	Water Service	SCHEDULE DATE: 1/29/2003	TIME: ALL
SEQUENCE #:	1	ORDER TAKEN BY:DAVISW2 1/24/2003 19:22:09	
SERVICE ADDRESS:	1311 E 4th St		
MAILING ADDRESS:	PO Box 681		
CITY/ST/ZIP:	Sterling IL 610812825	DISTRICT: Sterling	
CUSTOMER NAME:	Swart, Gary	BILLING CYCLE:	ACCOUNT #: 09-0408130-4
NEW CUSTOMER NAME:		WLPP: NO	PREMISES#: 090276871
BILL CLASS:	Residential	PHONE NUMBER:	8152880143
LAST NOTICE:		CALL BACK NUMBER:	8156316678
HEALTH ALERT:		CREW:Sterling	CREDIT TYPE: 0000
SERIAL NUMBER:		METER TYPE:	METER NUMBER:
# OF DIALS: SIZE:		INSTALL DATE:	REMOTE ID #:
MFG:		LAST TEST DATE:	
SERIAL NUMBER:	027561669	METER TYPE: 100CF	METER NUMBER: 027561669J
# OF DIALS: 4 SIZE: 5/8		INSTALL DATE: 4/01/1996	REMOTE ID #: 301136
MFG: Encoder Mtr 4dl		LAST TEST DATE: 3/01/1996	Touchpad Reading Device
TAP NUMBER:	009237325	PAST DUE AMOUNT:	LAST PAYMENT DATE: 12/06/2002
TAP SIZE:			LAST PAYMENT AMT: 21.67
TAP LOCATION:	6'S OF SHL-6'E OF E PROP LINE SINGLE		
MEASUREMENTS:	6'S OF SHL-6'E OF E	PROP LINESINGLE FAM	

CURRENT READ: 00000000 LAST S/O WORKED: 78553 HILOW 1/13/2003

DATE	READ	USE	RTP	DATE	READ	USE	RTP	DATE	READ	USE	RTP
01/16	1689	74	A	09/16	1576	1	A	06/14	1543	27	R
12/13	1615	34	A	08/15	1575	1	R	05/15	1516	39	R
11/14	1581	5	A	08/12	1574	11	R	04/15	1477	13	R
10/16	1576		A	07/16	1563	20	R	03/14	1464	10	R

PENDING SO: GET NEXT TO:
ADDRESS BEFORE:1308 E 4th St
ADDRESS AFTER: 307 14th Ave

CUR/RMVD METER: 27561669 DIAL #1 RDG: 7740 37 #2: #3:
NEW/SET METER: 76349625 DIAL #1 RDG: 0000 24 #2: #3:
METER LOCATION: Pulse Generating With Register

METER READ: 1'E OF SW; REMOTE METER ID: 301136; SVC #: 79 RS
COMMENTS:

METER: LOCKED STUCK DAMAGE/TAMPER REGIST:____ ____ sec/min
FOUND: ___ON ___OFF ___UN TO DETERMINE AT ___CORP ___STOP ___MB _____INSIDE
LEFT: ___ON ___OFF ___UN TO DETERMINE AT ___CORP ___STOP ___MB _____INSIDE

FOLLOW UP REQUIRED START DATE:_____ TIME:_____
COMPLETED BY:_____ DATE:_____ TIME:_____ KEYED:_

COMMENTS: CUSTOMER WANTS TO BE CALLED 1 HOUR AHEAD SO HE CAN BE THERE. 2:00
CUSTOMER WANTS METER TESTED AND WANTS TO BE THERE FOR THE TESTING
. CALL AT CELL 815-631-6678.
2-APTMENTS LEAK IN DOWNSTAIRS STOOL BAD ENOUGH TO NOT FILL TANK
DRIP IN TUB - UPSTAIRS STOOL HAD A SMALL LEAK -
REMOVED METER AS PER S.F.R. BROUGHT METER AND CONSUMER
IN TO OFFICE TO TEST METER METER RAN AT 99 LOW
FLOW 102 MIDDLE FLOW 101.3 HIGH FLOW - SET A NEW
METER & TOUCHPAD BECAUSE METER DID NOT PASS ON
MIDDLE FLOW

END OF SERVICE
END OF SERVICE ORDER #: 89284

EXHIBIT 3

S/O Maintenance by Account (SOAC) - CIS3025 - Illinois American (IL8) Production

Comment Lines

CUSTOMER WANTS TO BE CALLED 1 HOUR AHEAD SO HE CAN BE THERE.
CUSTOMER WANTS METER TESTED AND WANTS TO BE THERE FOR THE TESTING
. CALL AT CELL 815-691-6678.

1/29/03 SERVICEMAN 2 APARTMENT LEAK IN DOWNSTAIRS STOOL- BAD
ENOUGH TO NOT FILL TANK DRIP IN TUB UPSTAIRS STOOL HAD A LEAK
REMOVED METER FOR TEST CHANGED REMOVED 275261669 A-1740 SET
076349425 R-8 METER TESTED 94 LOW FLOW 102 MIDDLE FLOW 101.3
HIGH FLOW REPLACE THE TOUCH PAD AND METER OLD DID NOT PASS KFM
1/29

Meter Test & Inspection.

EXHIBIT 3

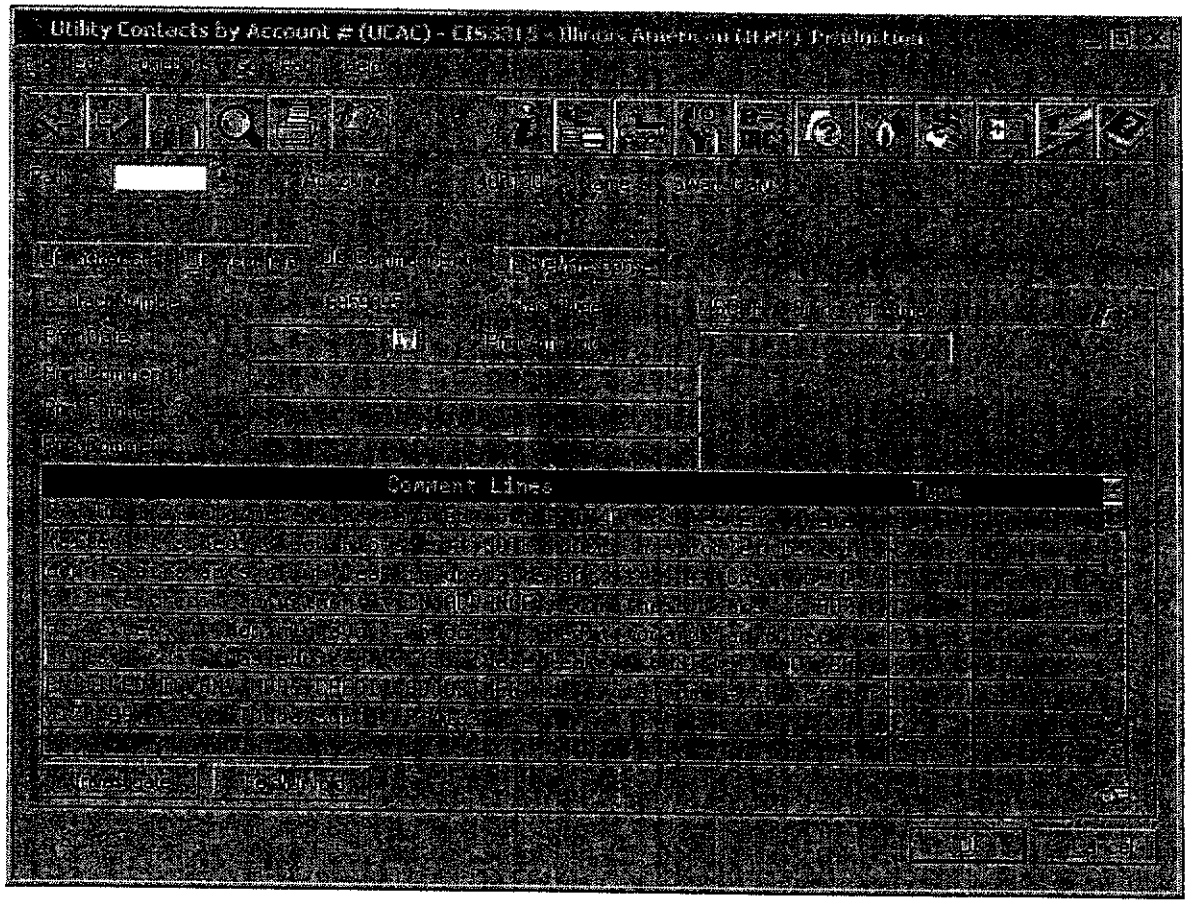

2/03/03

EXHIBIT 3